



Figure 1

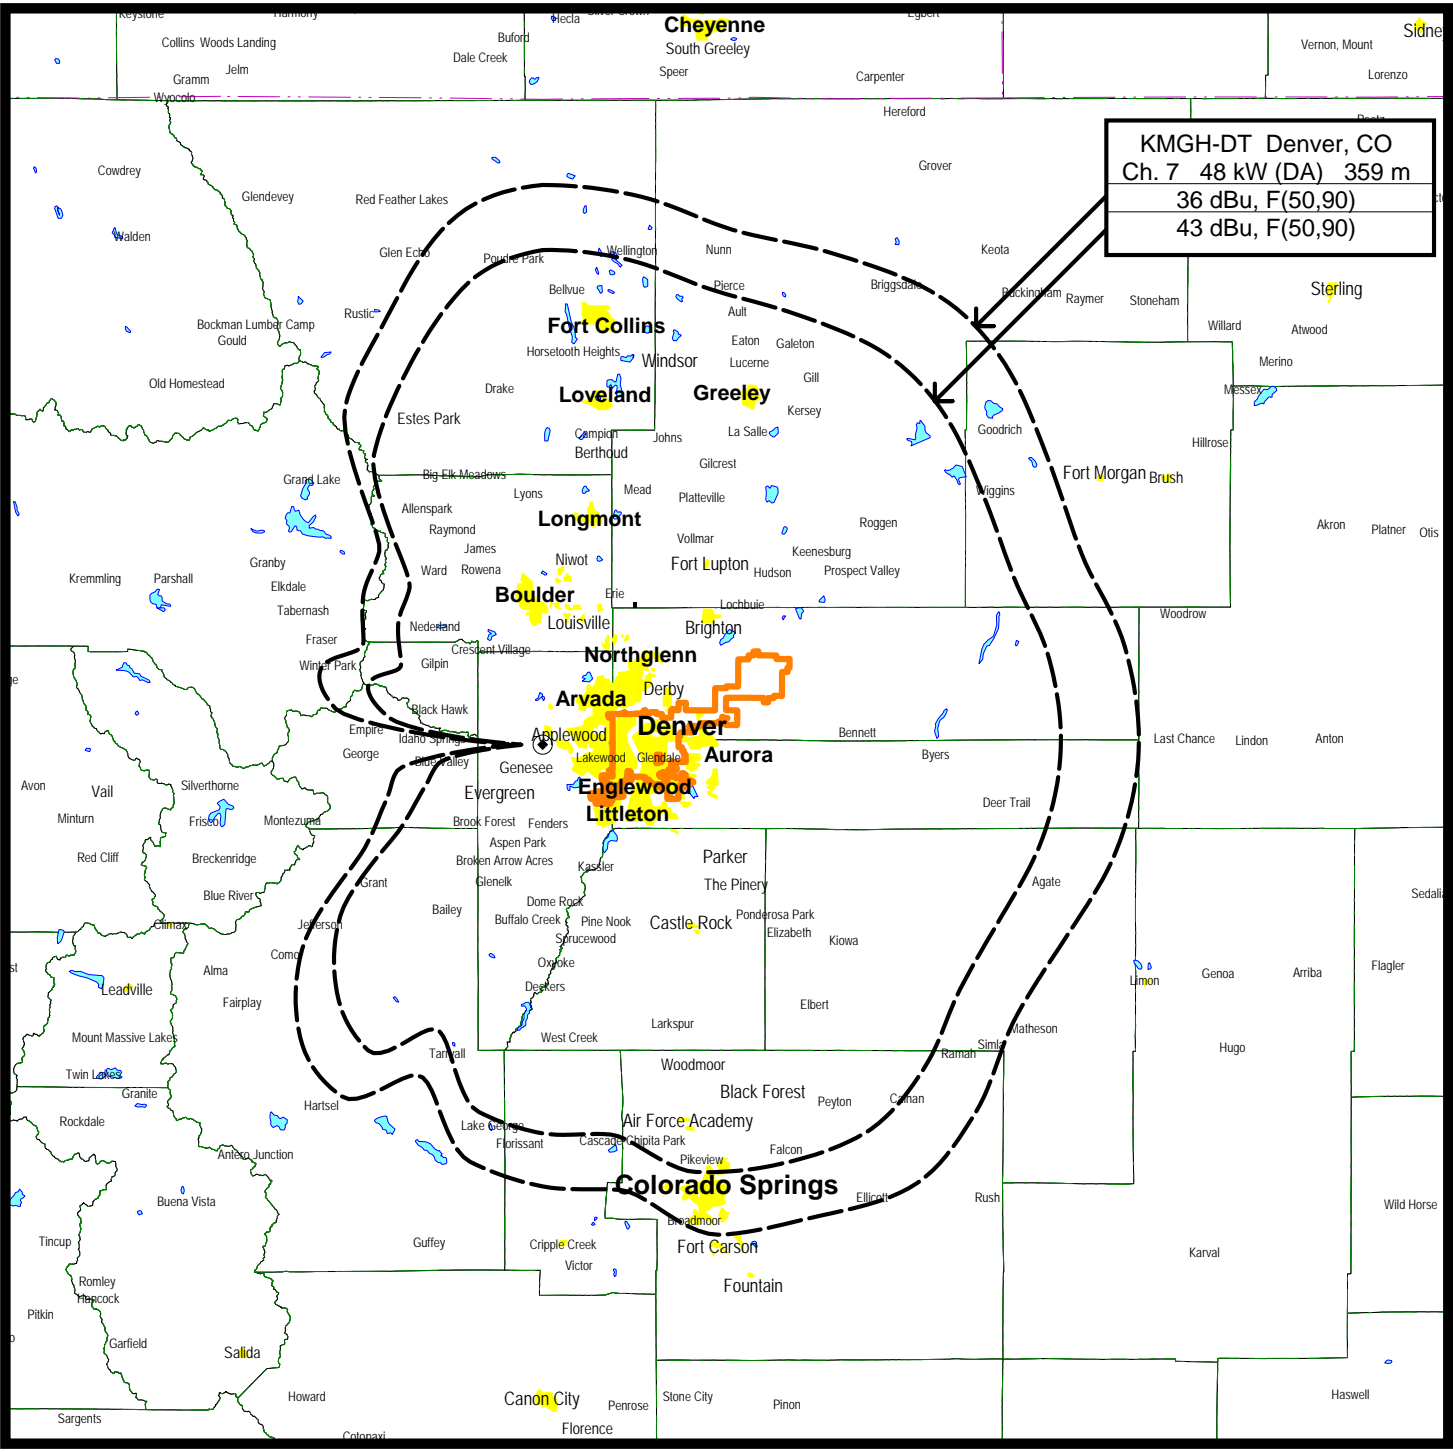

KMGH-DT Denver, CO  
Ch. 7 48 kW (DA) 359 m  
36 dBu, F(50,90)  
43 dBu, F(50,90)



## FCC PREDICTED COVERAGE CONTOURS

STATION KMGH-DT  
DENVER, COLORADO  
CH 7 48 KW (MAX-DA) 359 M

du Treil, Lundin & Rackley, Inc. Sarasota, Florida