


Figure 1

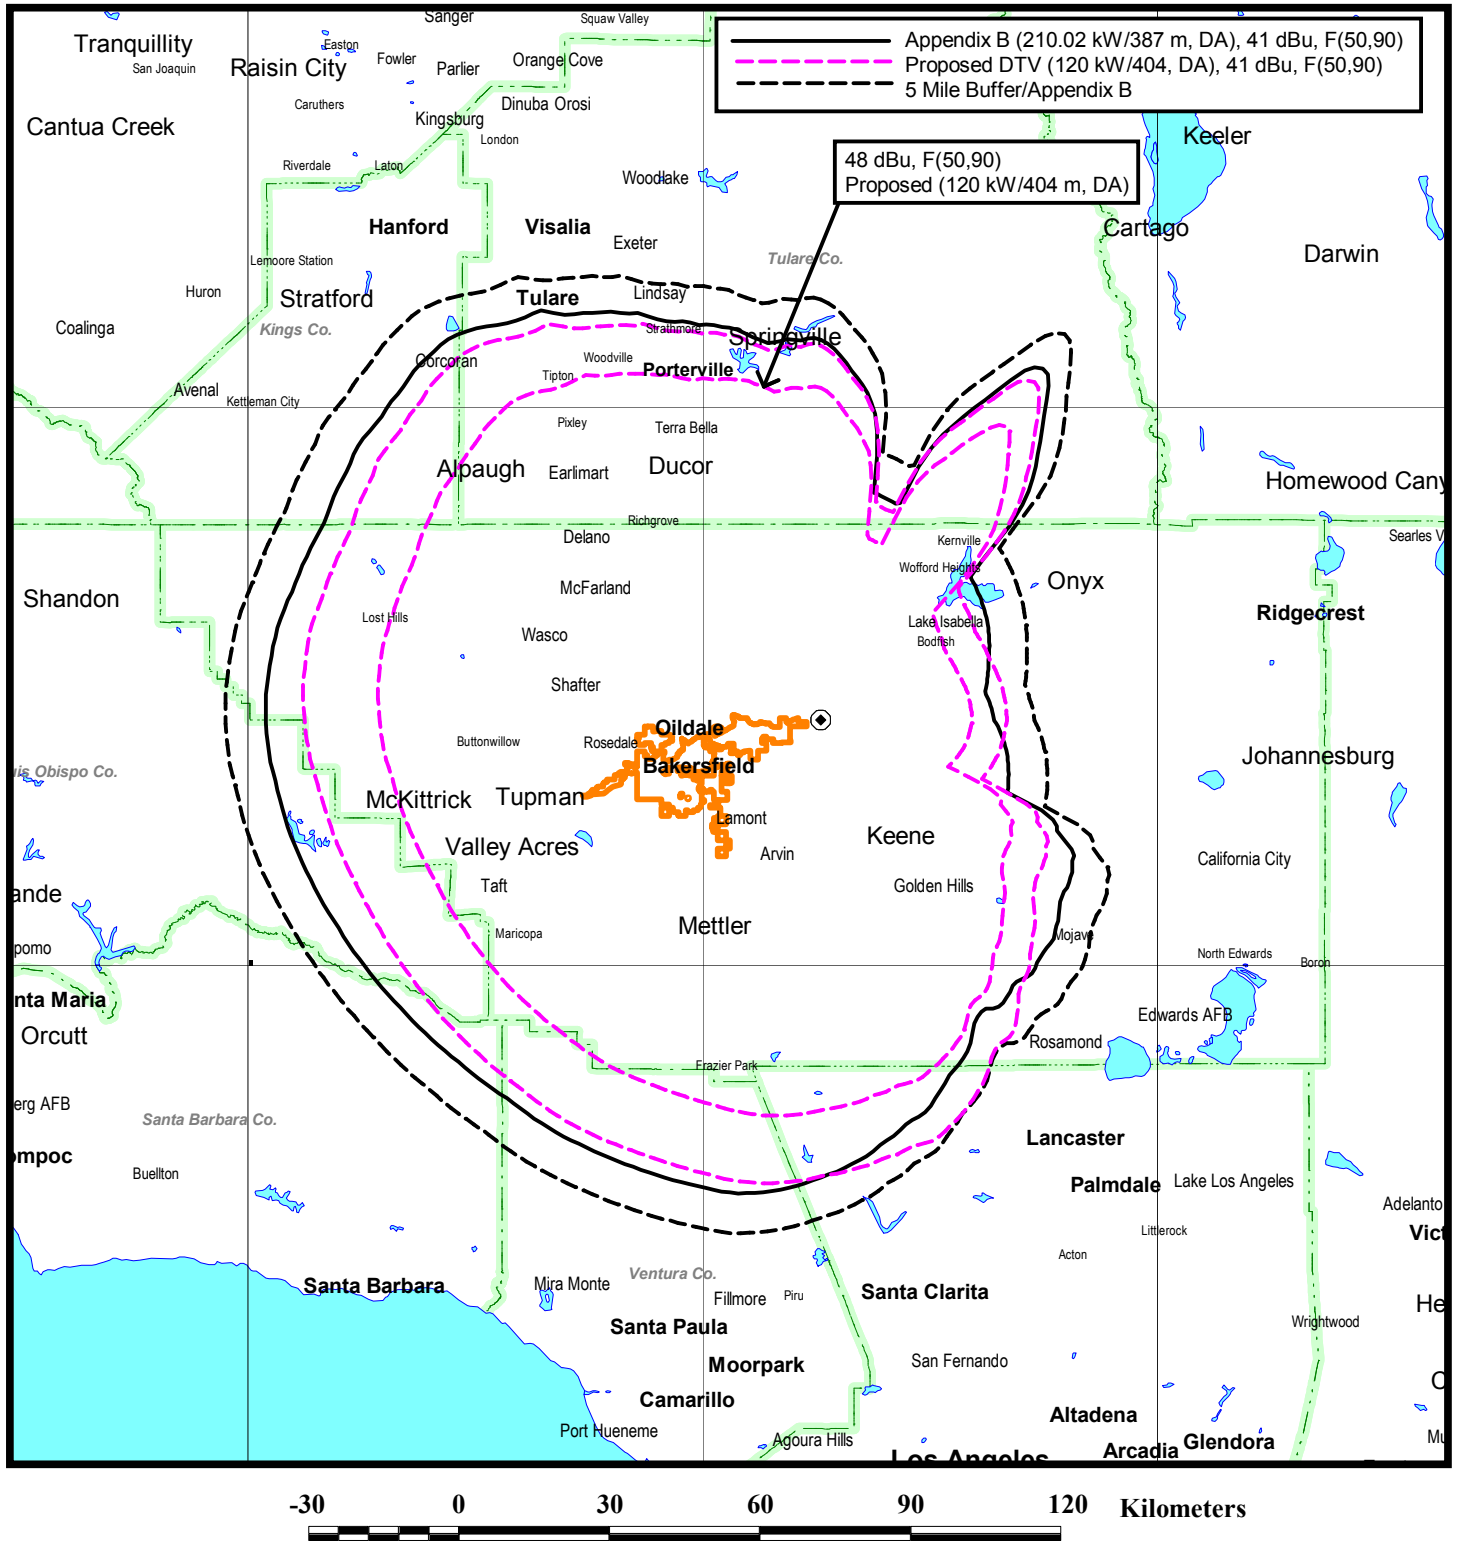

## FCC PREDICTED COVERAGE CONTOURS

STATION KUVI-DT  
BAKERSFIELD, CALIFORNIA  
CH 45 120 KW (MAX-DA) 404 M

du Treil, Lundin & Rackley, Inc. Sarasota, Florida