


Figure 1

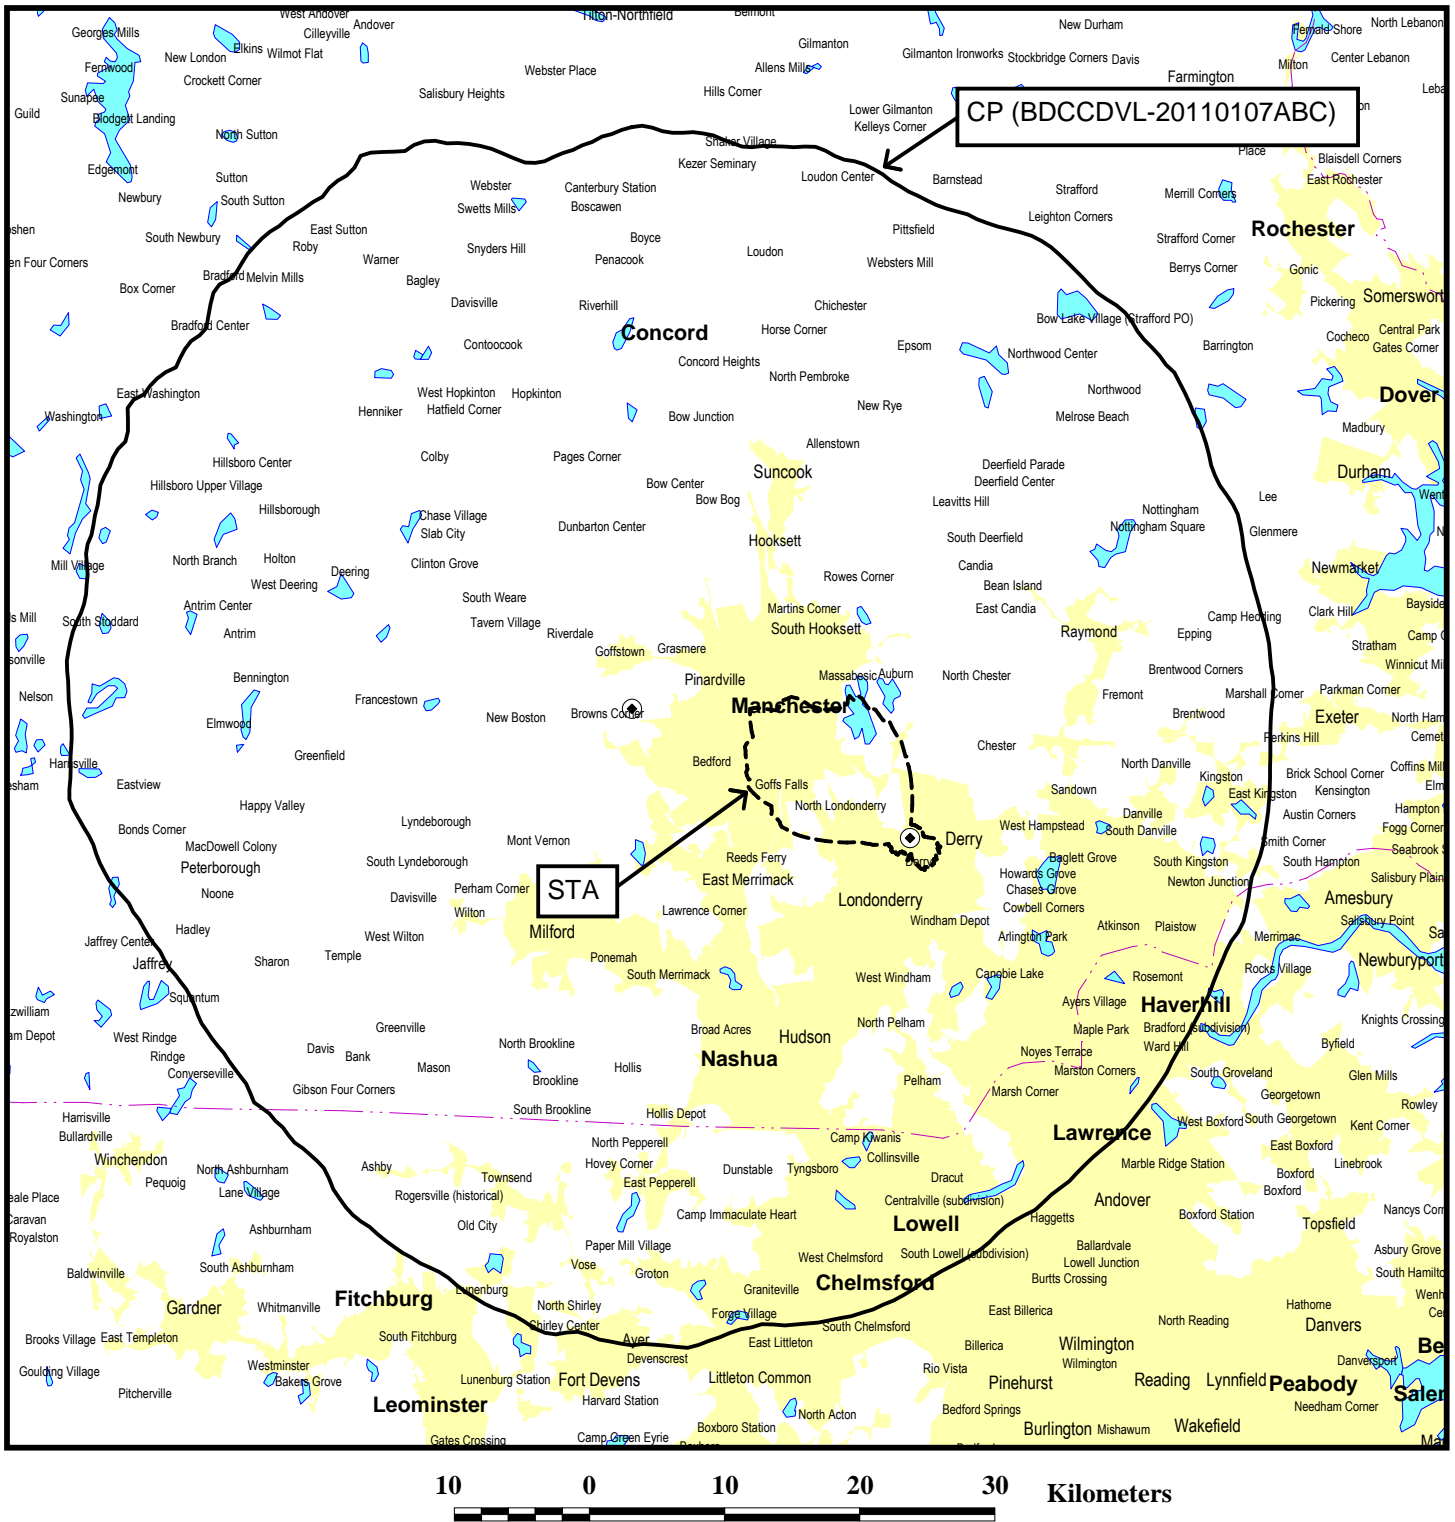

## FCC PREDICTED 48 DBU CONTOURS

STA OPERATION  
DCC STATION W07DR-D  
MANCHESTER, NEW HAMPSHIRE  
CH 7 0.062 KW (DA)

du Treil, Lundin & Rackley, Inc. Sarasota, Florida 34237