


Figure 1

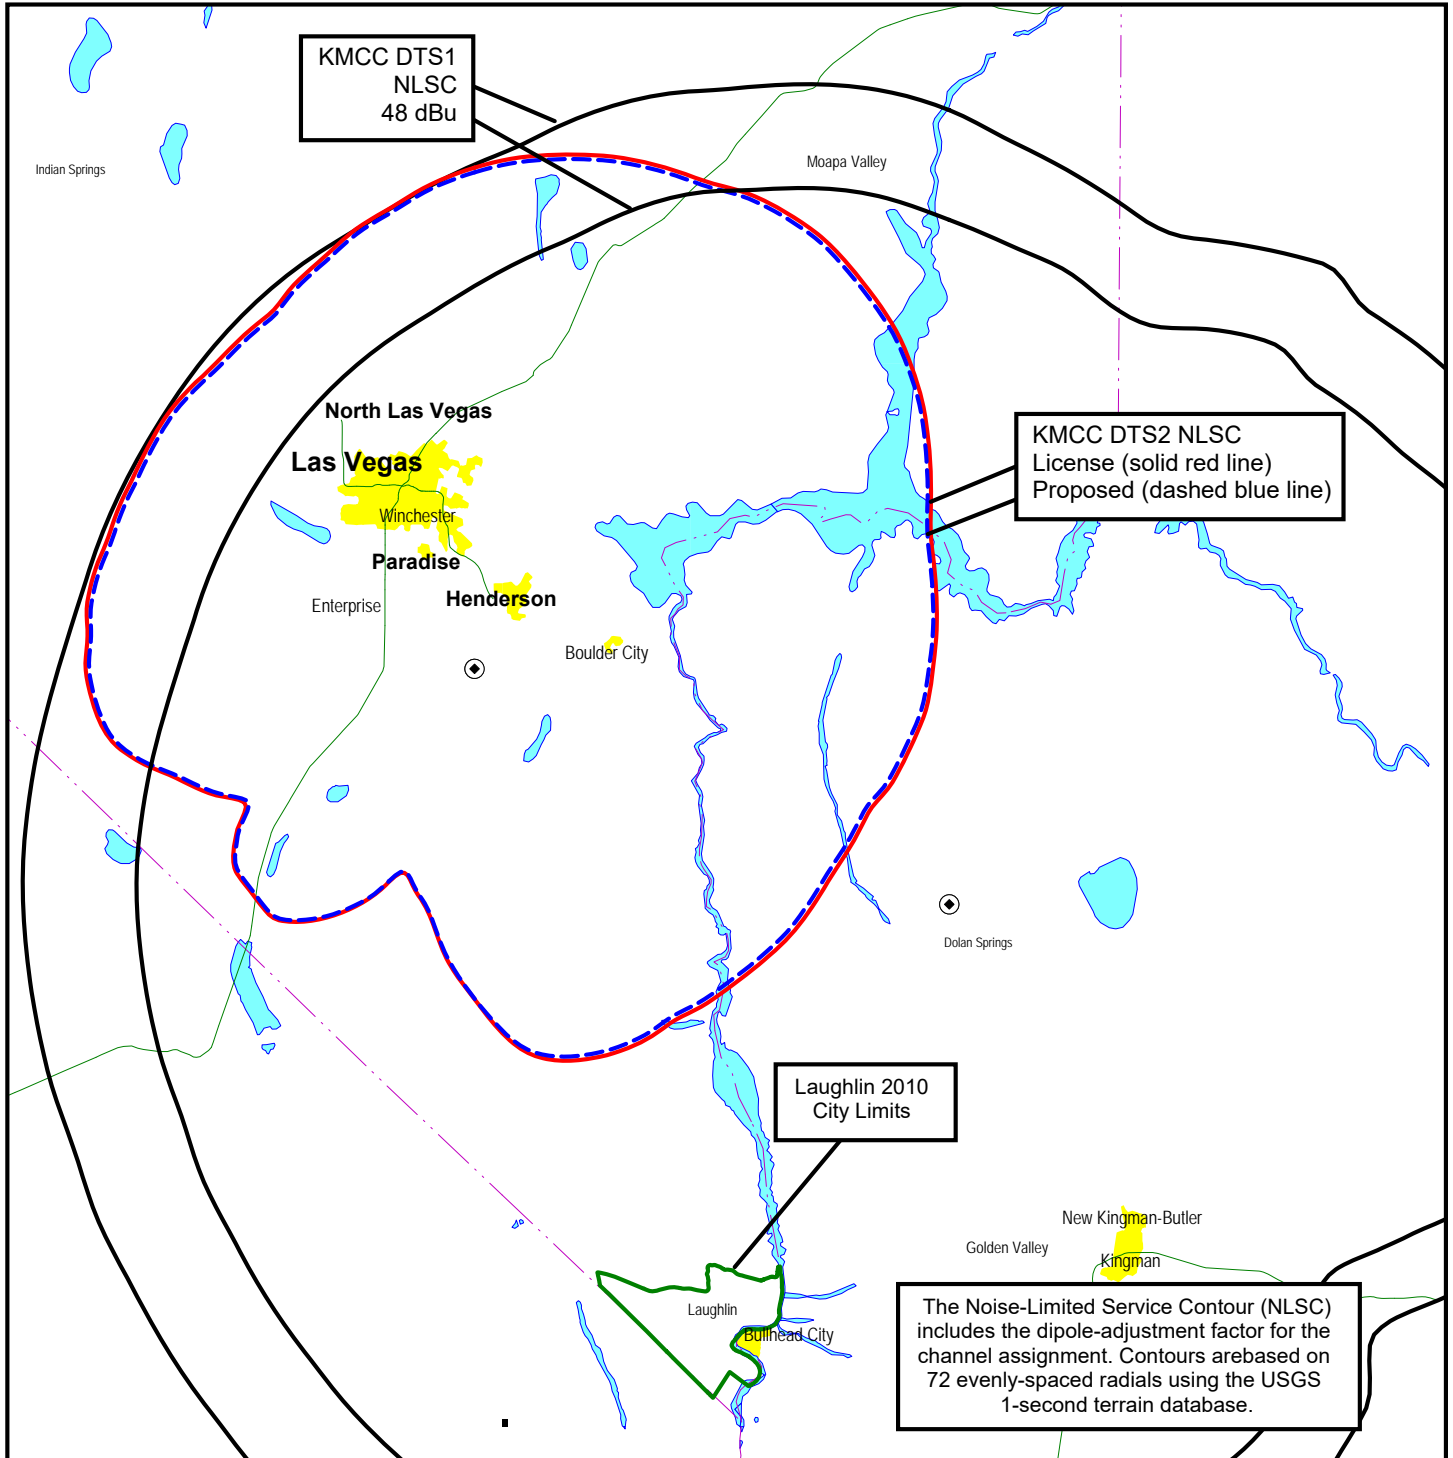

FCC PREDICTED COVERAGE CONTOURS

STATION KMCC DTS2
LAUGHLIN, NEVADA
CH 32 4.5 KW (DA) 557 M

du Treil, Lundin & Rackley, Inc. Sarasota, Florida