


Figure 1

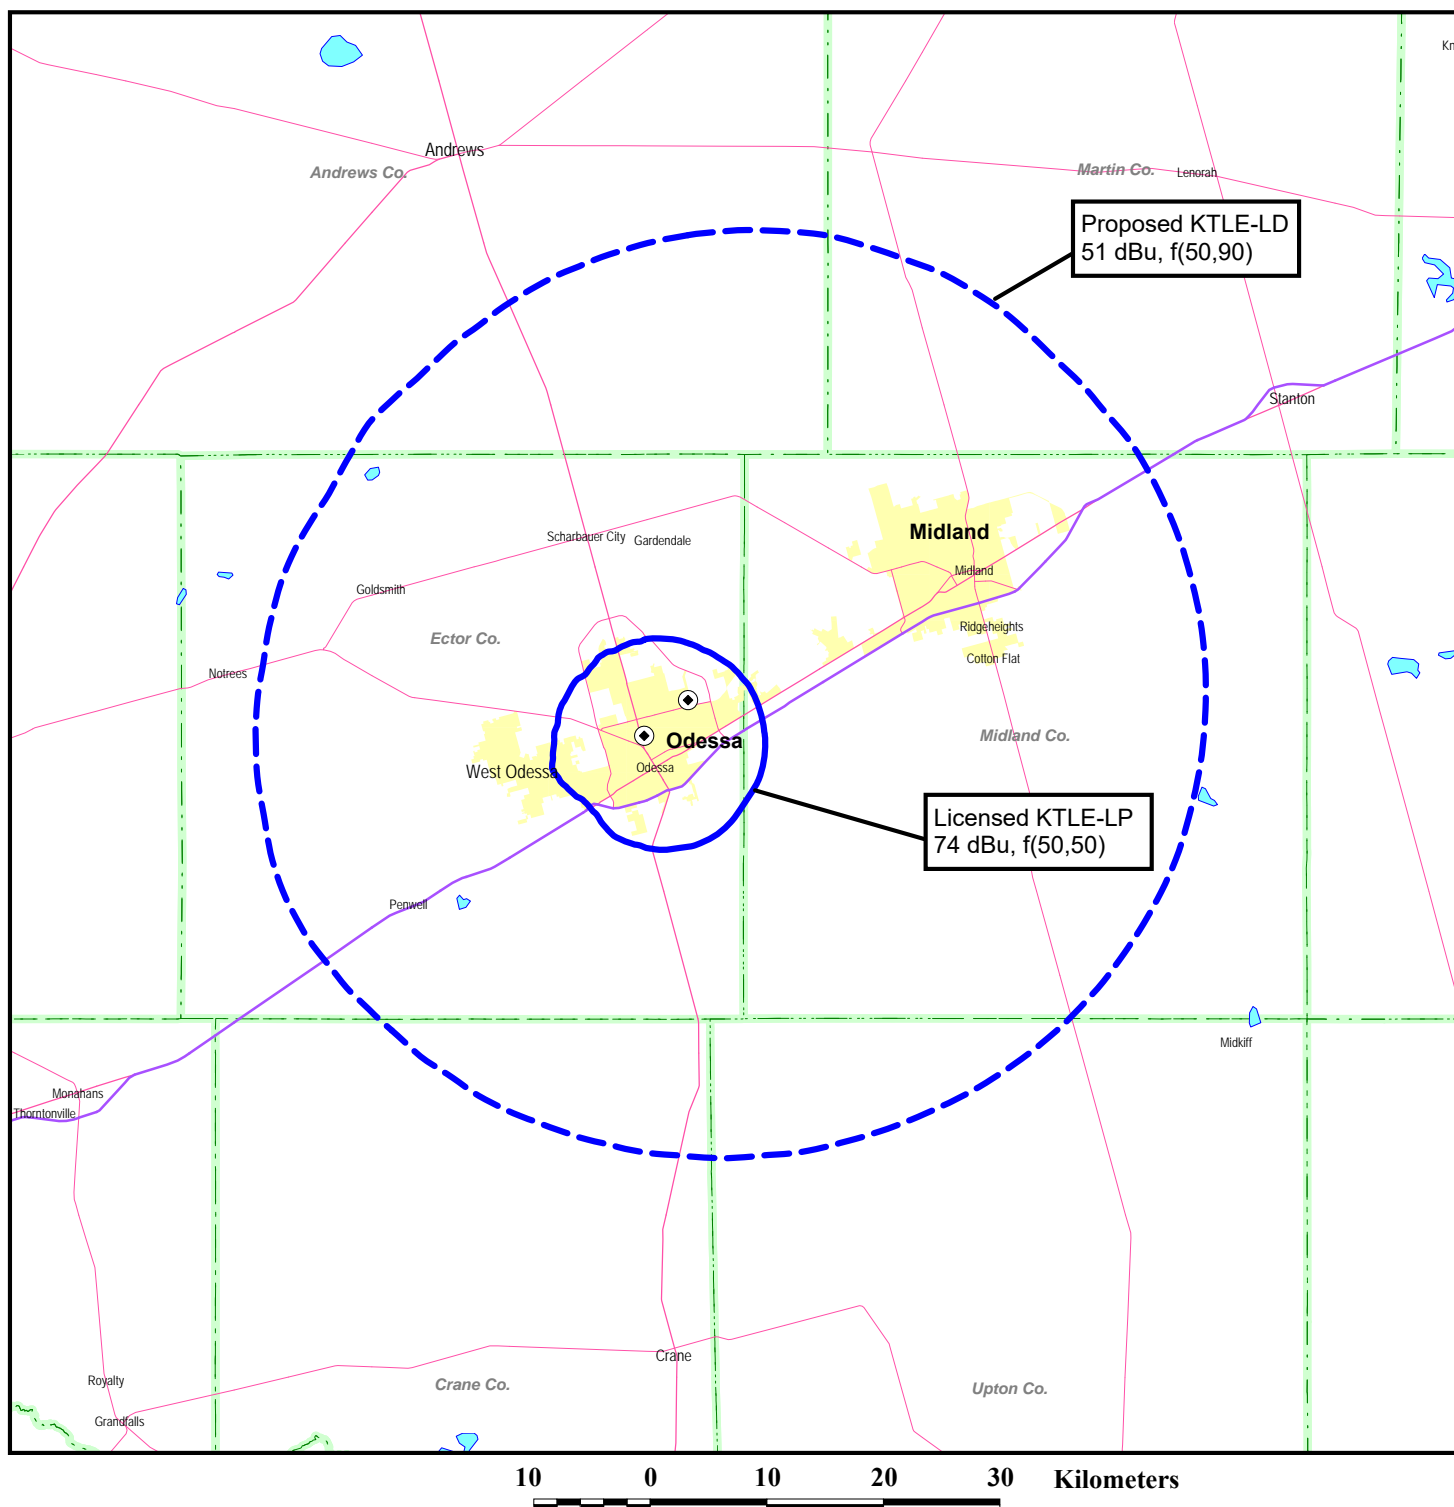

## FCC PREDICTED COVERAGE CONTOUR

STATION KTLE-LD  
ODESSA, TEXAS  
CH 20 15 KW (MAX-DA)

du Treil, Lundin & Rackley, Inc. Sarasota, Florida 34237