


## NEW NCE FM


---

COL	CLARKSDALE, MS
COOR	34 12 07.4 N 090 34 28.2 W
CH	201
ASR	NA
GROUND	53
TOWER	12
AGL	12
COR	65
HAAT	17.6
CLASS	A
POWER	0.3
DA	N
POP	19479
AREA	173.3
307B	YES - SECOND SERVICE

Community of License 60 dBu

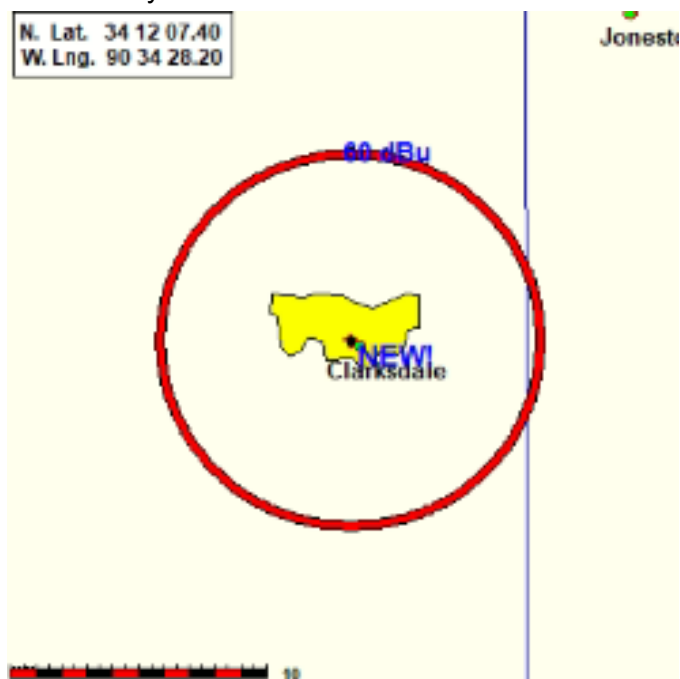

## FAIR DISTRIBUTION OF SERVICE

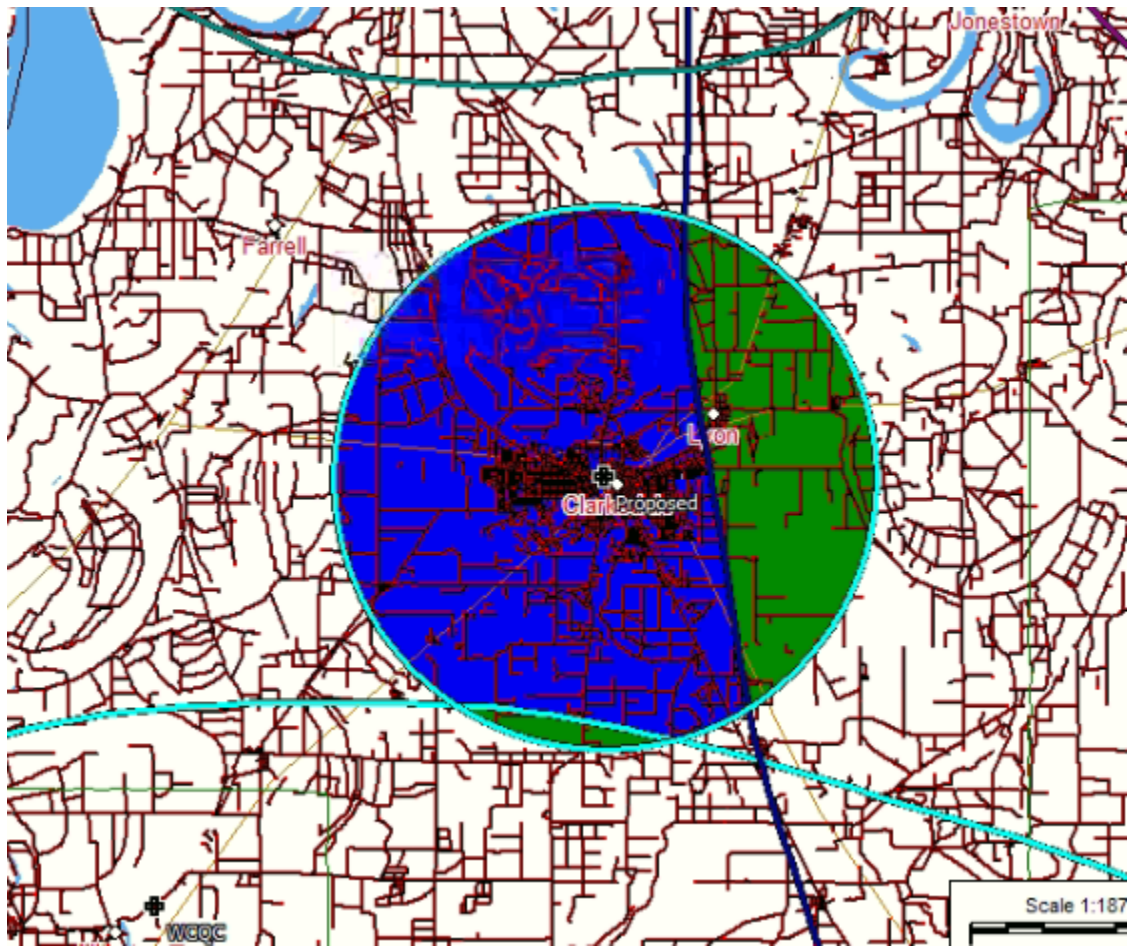

Blue = Secondary Service

### Service Count Population Report

Population Database: 2010 US Census (PL)

	Service Pop	Running Total	%
2nd Service	18,718	18,718	96.1
3rd Service (or >)	761	19,479	100.0

**SECOND SERVICE OF 18718 PERSONS**

## CONTOUR ENGINEERING

REFERENCE CH# 201B1- 88.1 MHz, Pwr= 0.3 kW, HAAT= 17.6 M, COR= 65 M DISPLAY DATES  
 34 12 07.4 N. Average Protected F(50-50)= 7.4 km DATA 10-21-21  
 90 34 28.2 W. Omni-directional SEARCH 10-28-21

CH	CALL	TYPE	ANT	AZI.	DIST	LAT.	Pwr (kW)	INT (km)	PRO (km)	*IN*	*OUT*
CITY		STATE		<--	FILE #	LNG.	HAAT (M)	COR (M)	LICENSEE	(Overlap	in km)
204C1	WYTF	LIC	DVN	182.3	68.57	33 35 03.40	100.000	7.8	61.9	53.4	5.5
Indianola			MS	2.2	BLED20040901AAU	90 36 13.30	194	229	American Family Associatio		
254A	WNEV«	LIC	NCN	342.4	19.04	34 21 56.40	6.000	1.9	28.1	11.5R	7.5M
Friars Point			MS	162.4	BLH20090629ADF	90 38 14.40	100	148	L.T. Simes II & Raymond Si		
201C3	KARH	LIC	CN	0.4	111.05	35 12 11.30	4.200	90.2	32.2	13.5	53.9
Forrest City			AR	180.4	BLED20090811AAY	90 33 57.40	155	217	American Family Associatio		
201A	WURC	LIC	CN	57.7	121.88	34 46 53.30	3.000	73.8	22.9	40.7	74.1
Holly Springs			MS	238.4	BLED19880711KC	89 26 49.30	83	231	Rust College, Inc.		
201C1	KBPW	LIC	VN	247.6	190.18	33 32 11.40	60.000	134.2	45.7	48.6	119.6
Hampton			AR	66.5	BLED20010824AAE	92 28 07.60	103	153	American Family Associatio		

Terrain database is NGDC 30 SEC, R= 73.215 qualifying spacings or FCC minimum spacings in KM, M= Margin in KM  
 Contour distances are on direct line to and from reference station. Reference Zone= - Zone 2, Co to 3rd adjacent.  
 All separation margins (if shown) include rounding.  
 Ant Column: (D= DA Standard, Z= DA 73.215, N= Not DA 73.215, \_= Omni), Polarization (C,H,V,E), Beamtilt(Y,N,X)  
 "\*"affixed to 'IN' or 'OUT' values = site inside restricted contour.  
 « = Station meets FCC minimum distance spacing for its class.

### Non-Ionizing Electromagnetic Radiation (NEIR) Analysis

The applicant hereby requests that a Construction Permit be granted with the condition that RF measurements be conducted before the facility is constructed. The applicant will thereupon submit the results of these measurements, prior to Commission grant of Program Test Authority. If the results of the measurements reveal that there are areas that would exceed the MPE requirements for controlled or uncontrolled areas, the applicant will take all necessary measures, including but not limited to fencing and/or signage, to fully comply with the RF exposure limits.