


Figure 2

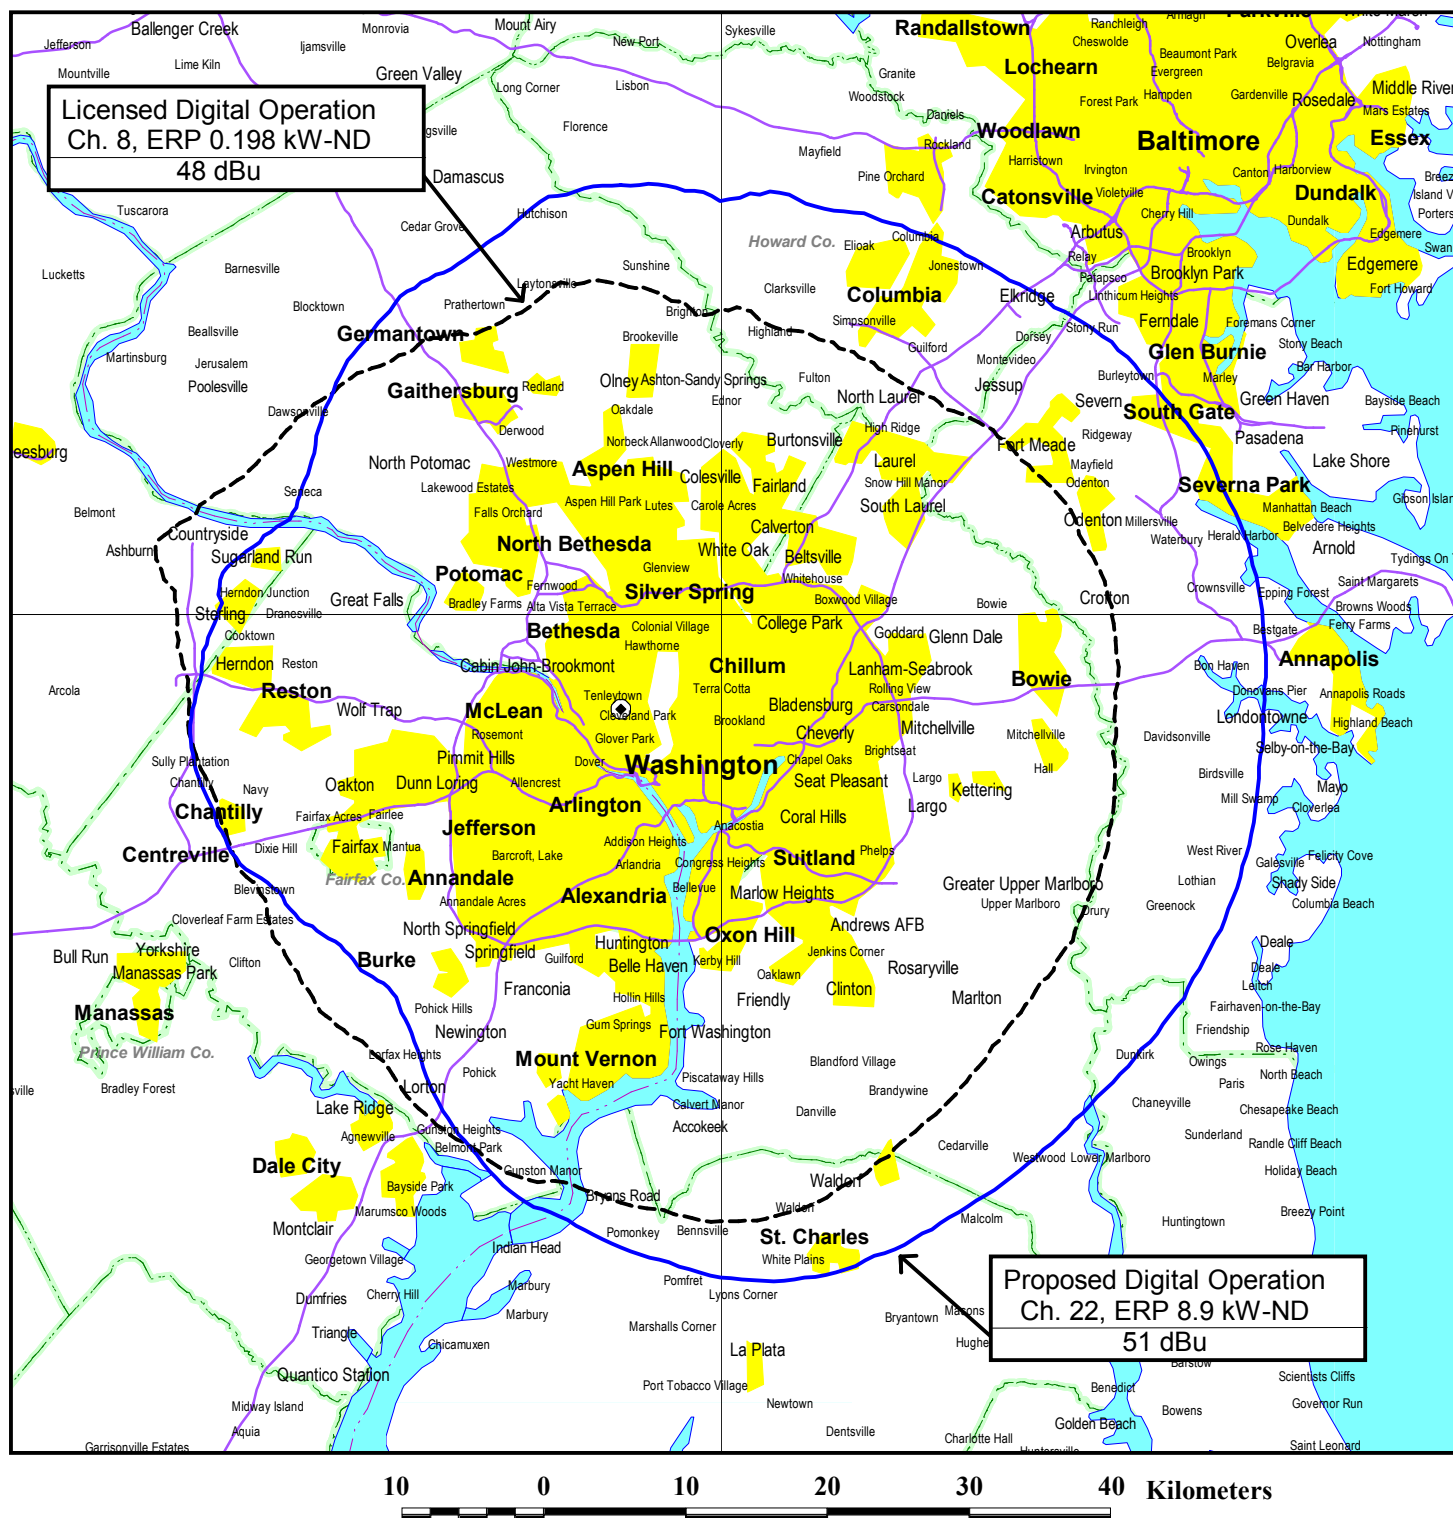

FCC PREDICTED COVERAGE CONTOURS

STATION WMDO-LD
WASHINGTON, DC
CH 22 8.9 KW (MAX-DA)

du Treil, Lundin & Rackley, Inc. Sarasota, Florida 34237