


Clearance is shown with co-owned WLGH. Appropriate protected and interfering contours with respect to each station was used as required by 73.509.

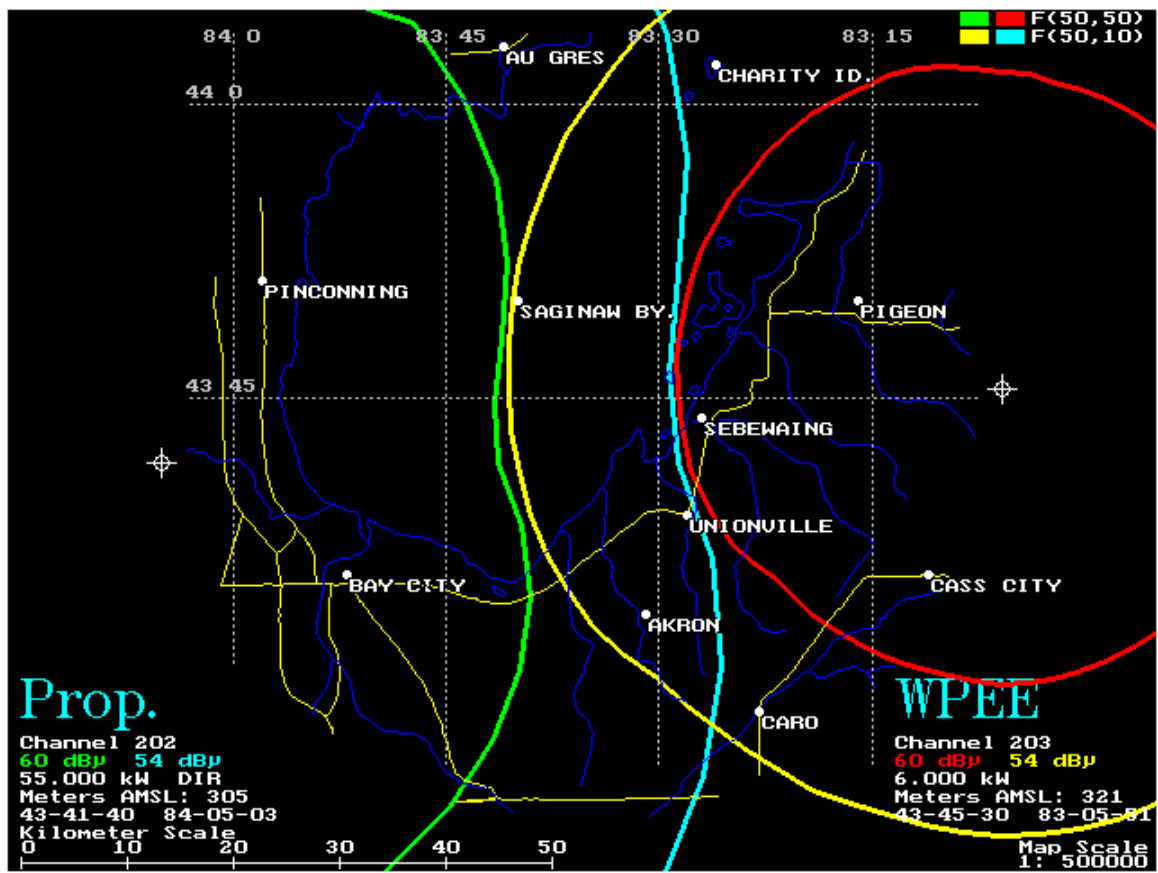

Clearance is shown with WP EE. Appropriate protected and interfering contours with respect to each station was used as required by 73.509.