


Figure 1

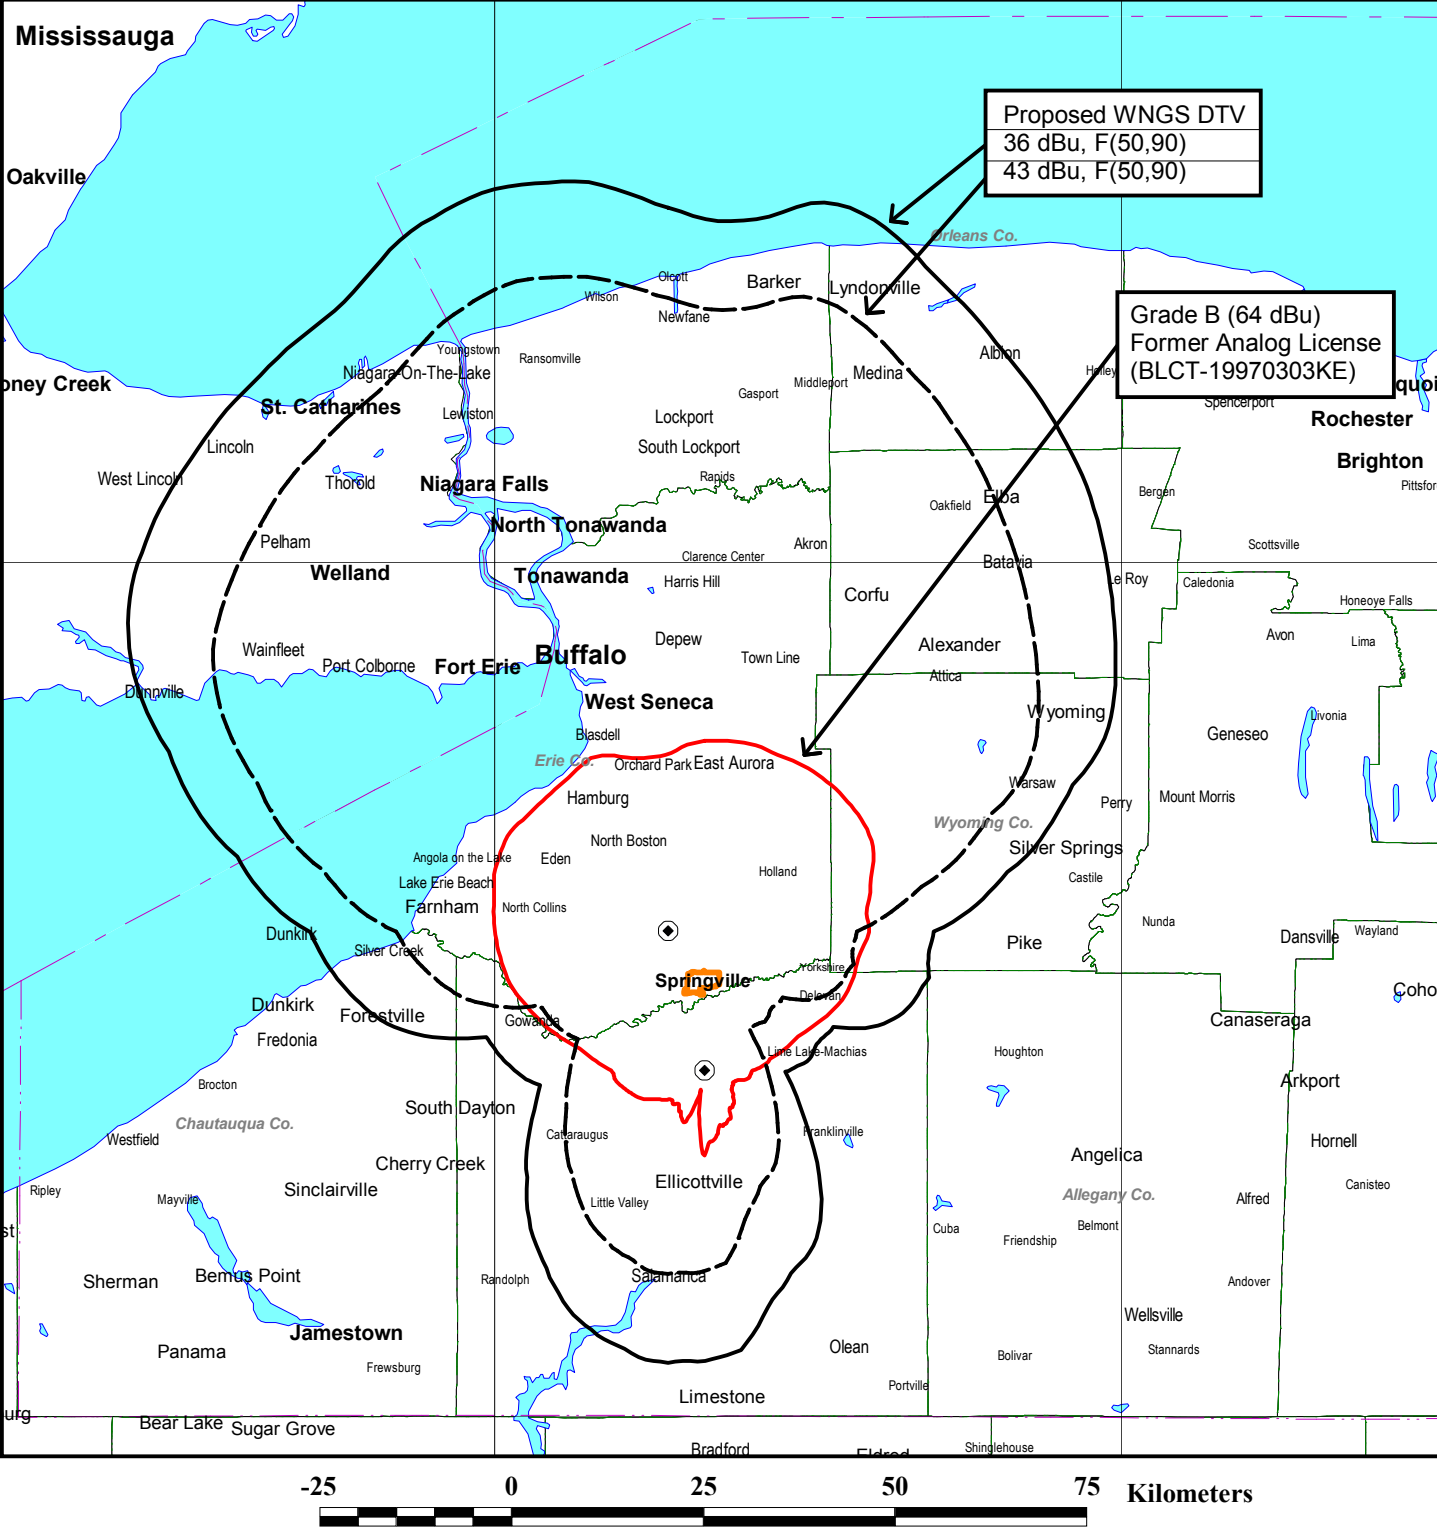

## FCC PREDICTED COVERAGE CONTOURS

DTV STATION WNGS  
SPRINGVILLE, NEW YORK  
CH 7 26.9 KW (MAX-DA) 183 M

du Treil, Lundin & Rackley, Inc. Sarasota, Florida