


CH 300 L1 107.9 MHz

Current Spacings to 2nd Adj.

Calvary Chapel Morris Hills

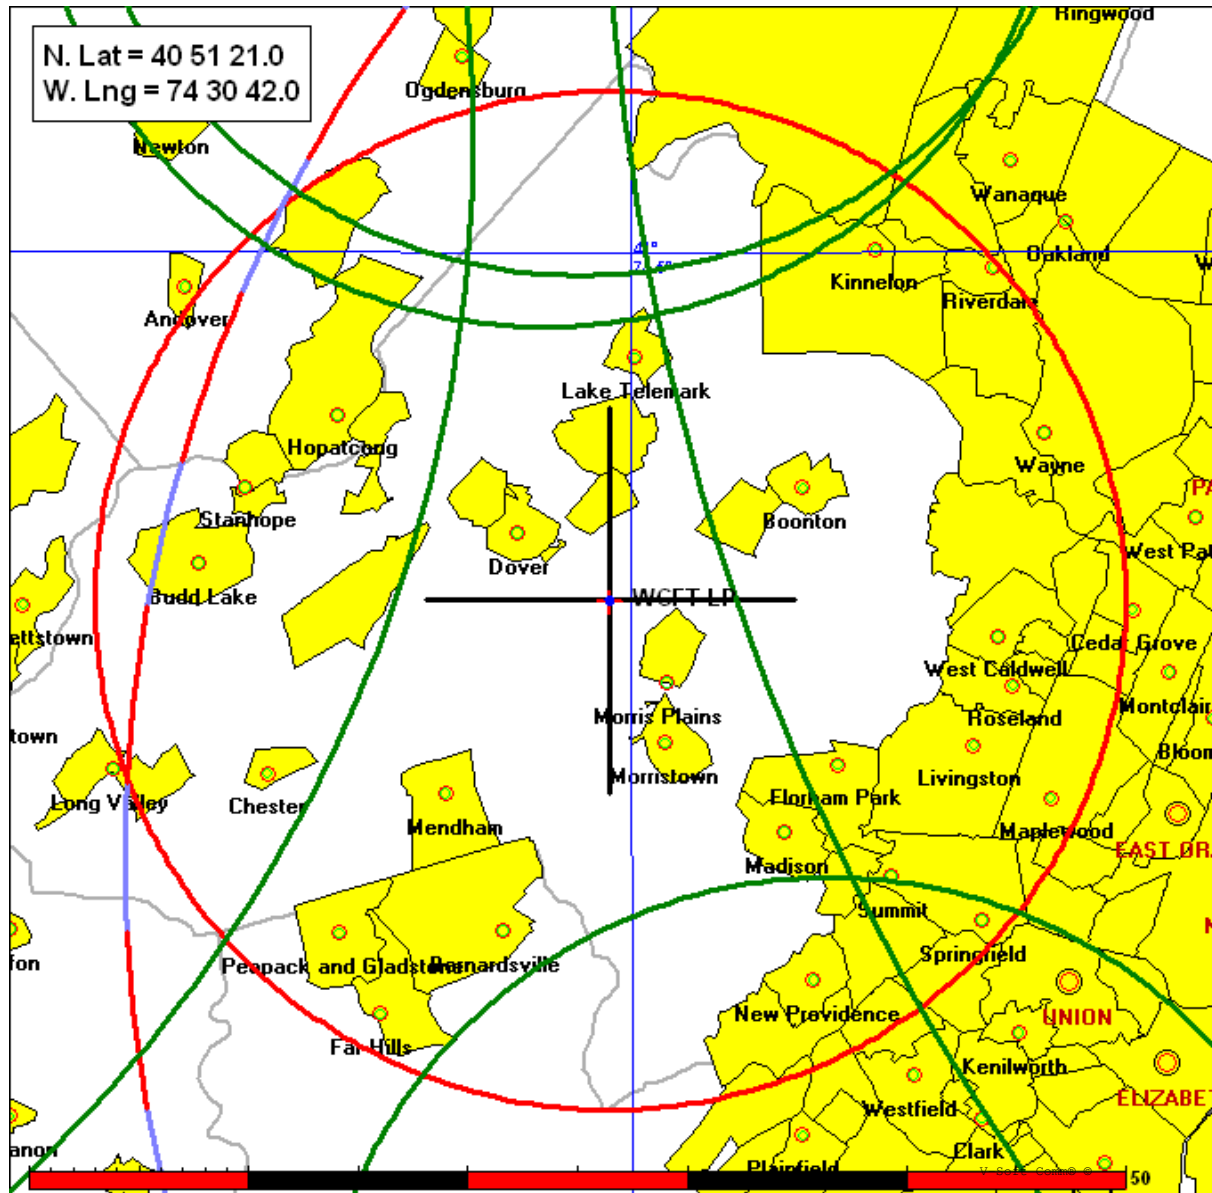

Data Date:07-01-16 Job Date:07-05-16

Call	CH#	Type	Location	Azi	D-KM	FCC	Margin
	Lat.		Lng. Ant	Power	HAAT		
WCFT-LP	300L1	LIC	Dover	NJ	0.0	0.00	23.5
	40 51 21.0		74 30 42.0	0.004 kW		148 M	-23.5
WBLS	298B	LIC	New York	NY	104.9	45.92	66.5
	40 44 54.0		73 59 10.0	4.200 kW		415 M	-20.6
WEBE	300B	LIC	Westport	CT	72.1	116.96	111.5
	41 10 14.0		73 11 05.0	50.000 kW		117 M	5.5
WKRF	300A	LIC	Tobyhanna	PA	286.4	75.84	66.5
	41 02 39.3		75 22 39.1	0.830 kW		268 M	9.3
WSRX-LP	300L1	LIC	Vernon	NJ	355.3	36.24	23.5
	41 10 52.0		74 32 50.0	0.100 kW	0 M		12.7
WOLD-LP	300L1	LIC	Woodbridge	NJ	164.5	37.64	23.5
	40 31 45.0		74 23 34.0	0.016 kW		73 M	14.1
WSRX-LP.C	300L1	CP	Vernon	NJ	358.0	38.52	23.5
	41 12 09.0		74 31 39.0	0.100 kW		-7 M	15.0

All separation margins include rounding