


Figure 3

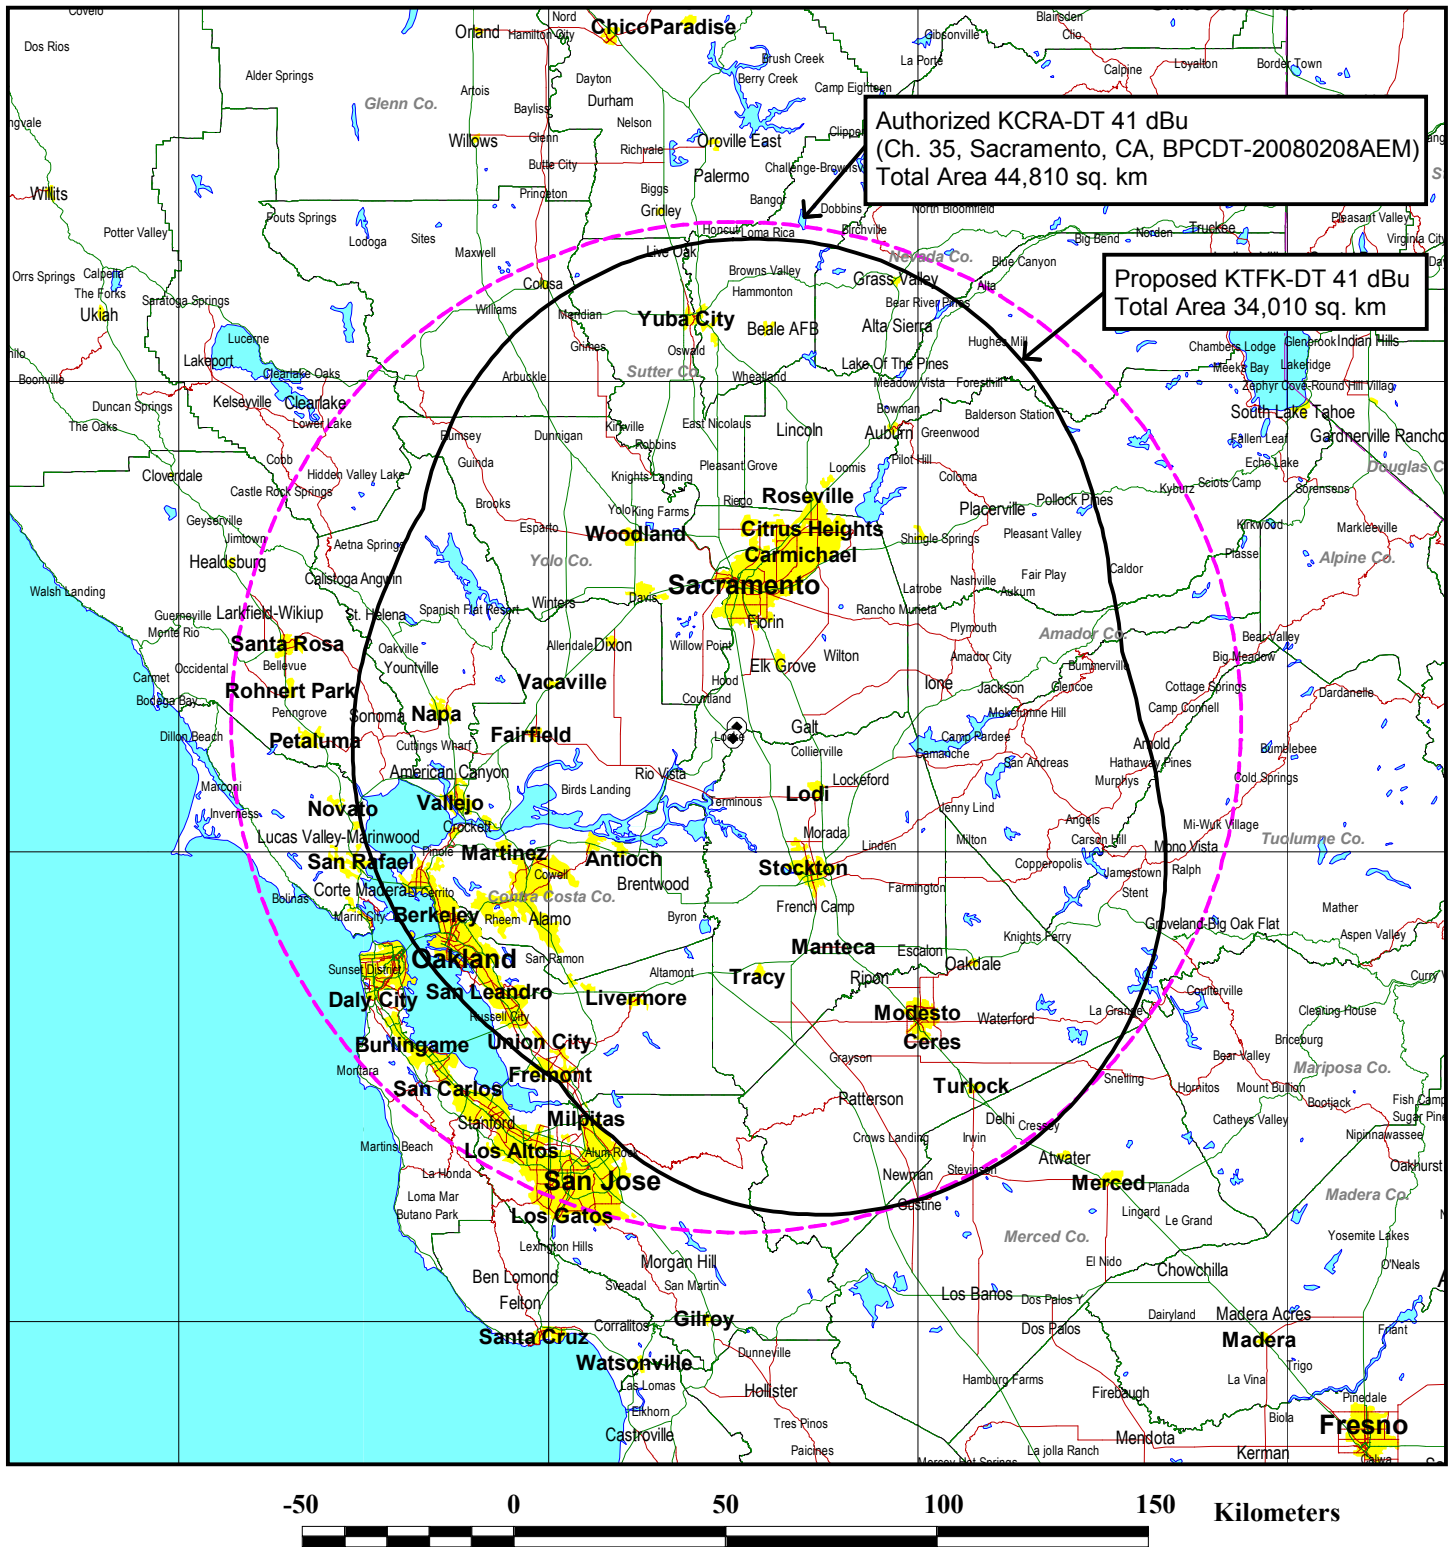

SECTION 73.622(f)(5) COMPLIANCE

STATION KTFK-DT
 STOCKTON, CALIFORNIA
 CH 26 850 KW (MAX-DA) 595 M

du Treil, Lundin & Rackley, Inc. Sarasota, Florida