


Figure 2

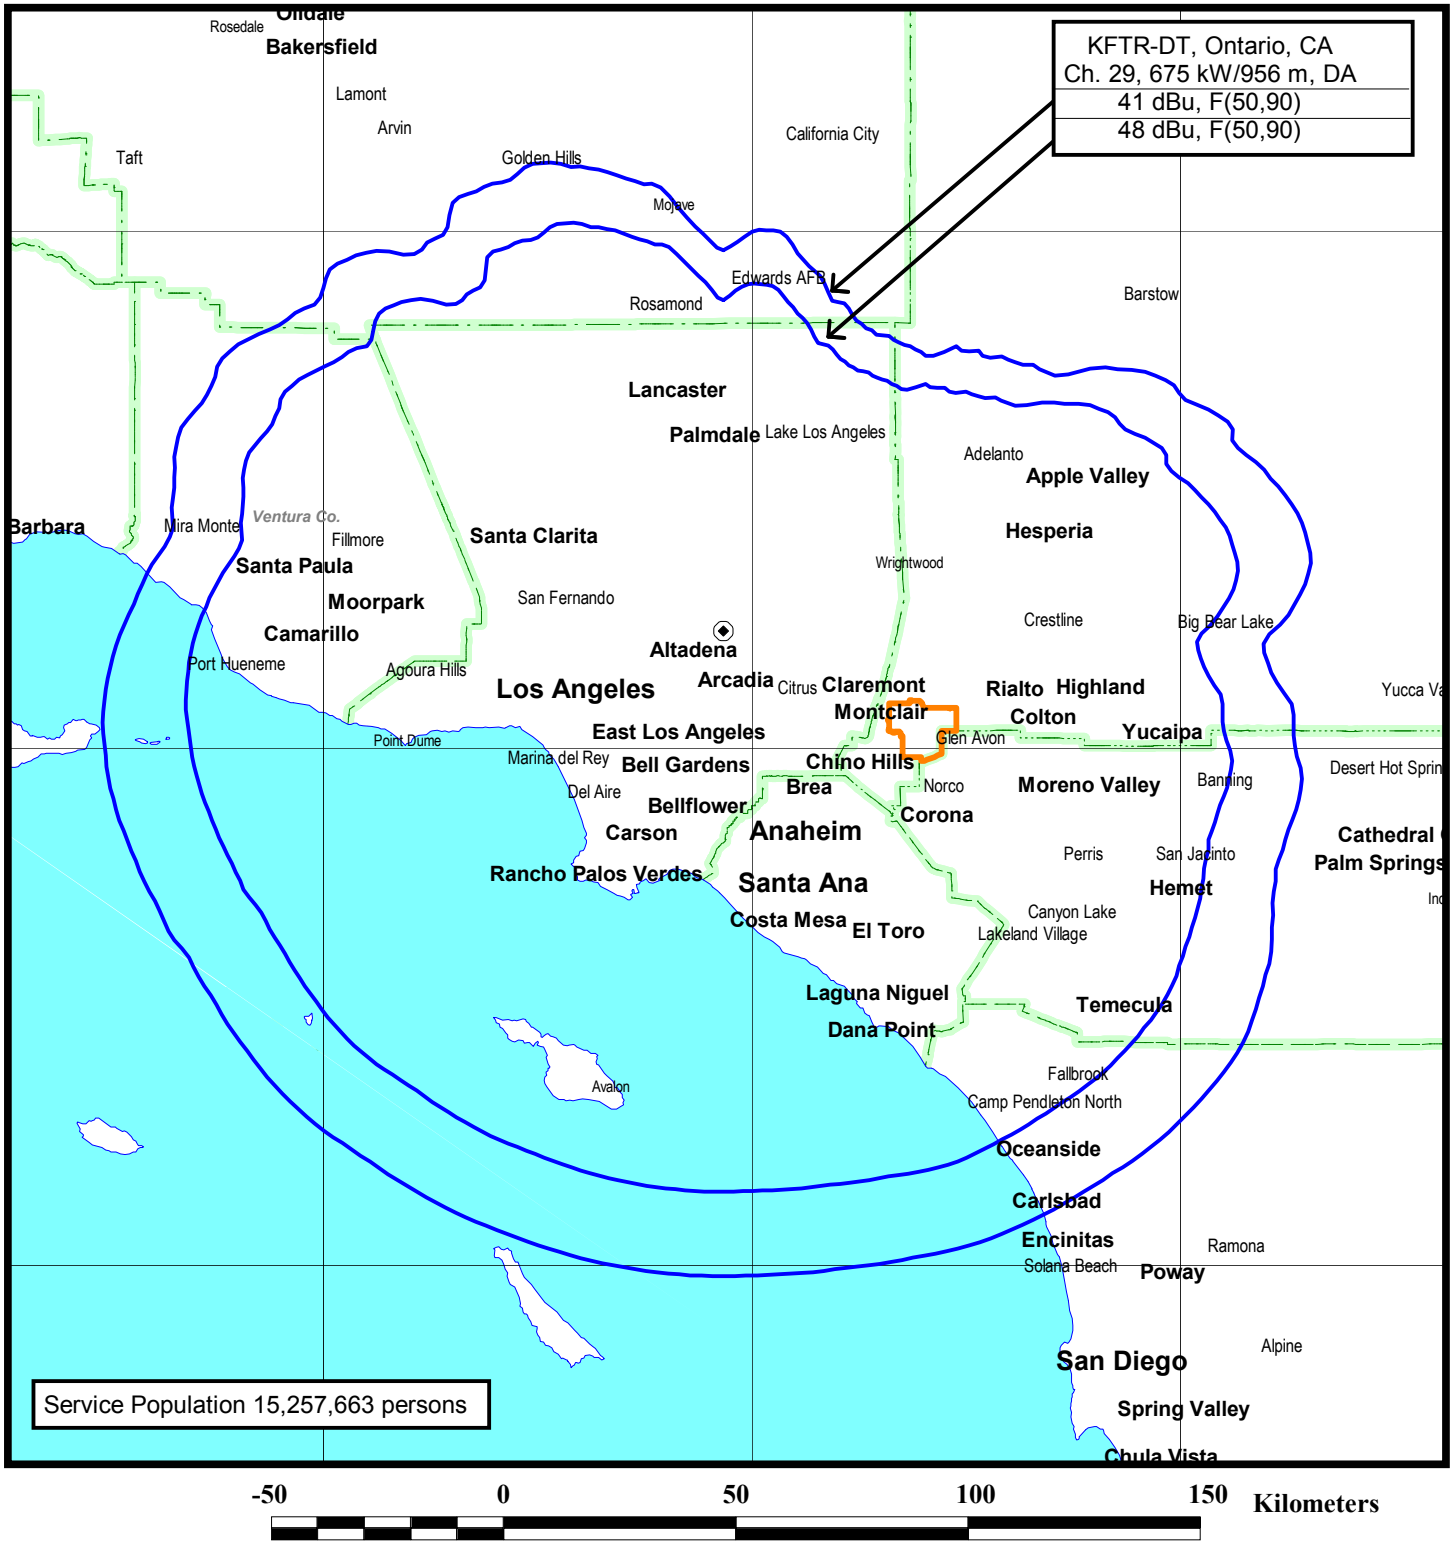

FCC PREDICTED COVERAGE CONTOURS

STATION KFTR-DT
ONTARIO, CALIFORNIA
CH 29 675 KW (MAX-DA) 956 M

du Treil, Lundin & Rackley, Inc. Sarasota, Florida