


Figure 1

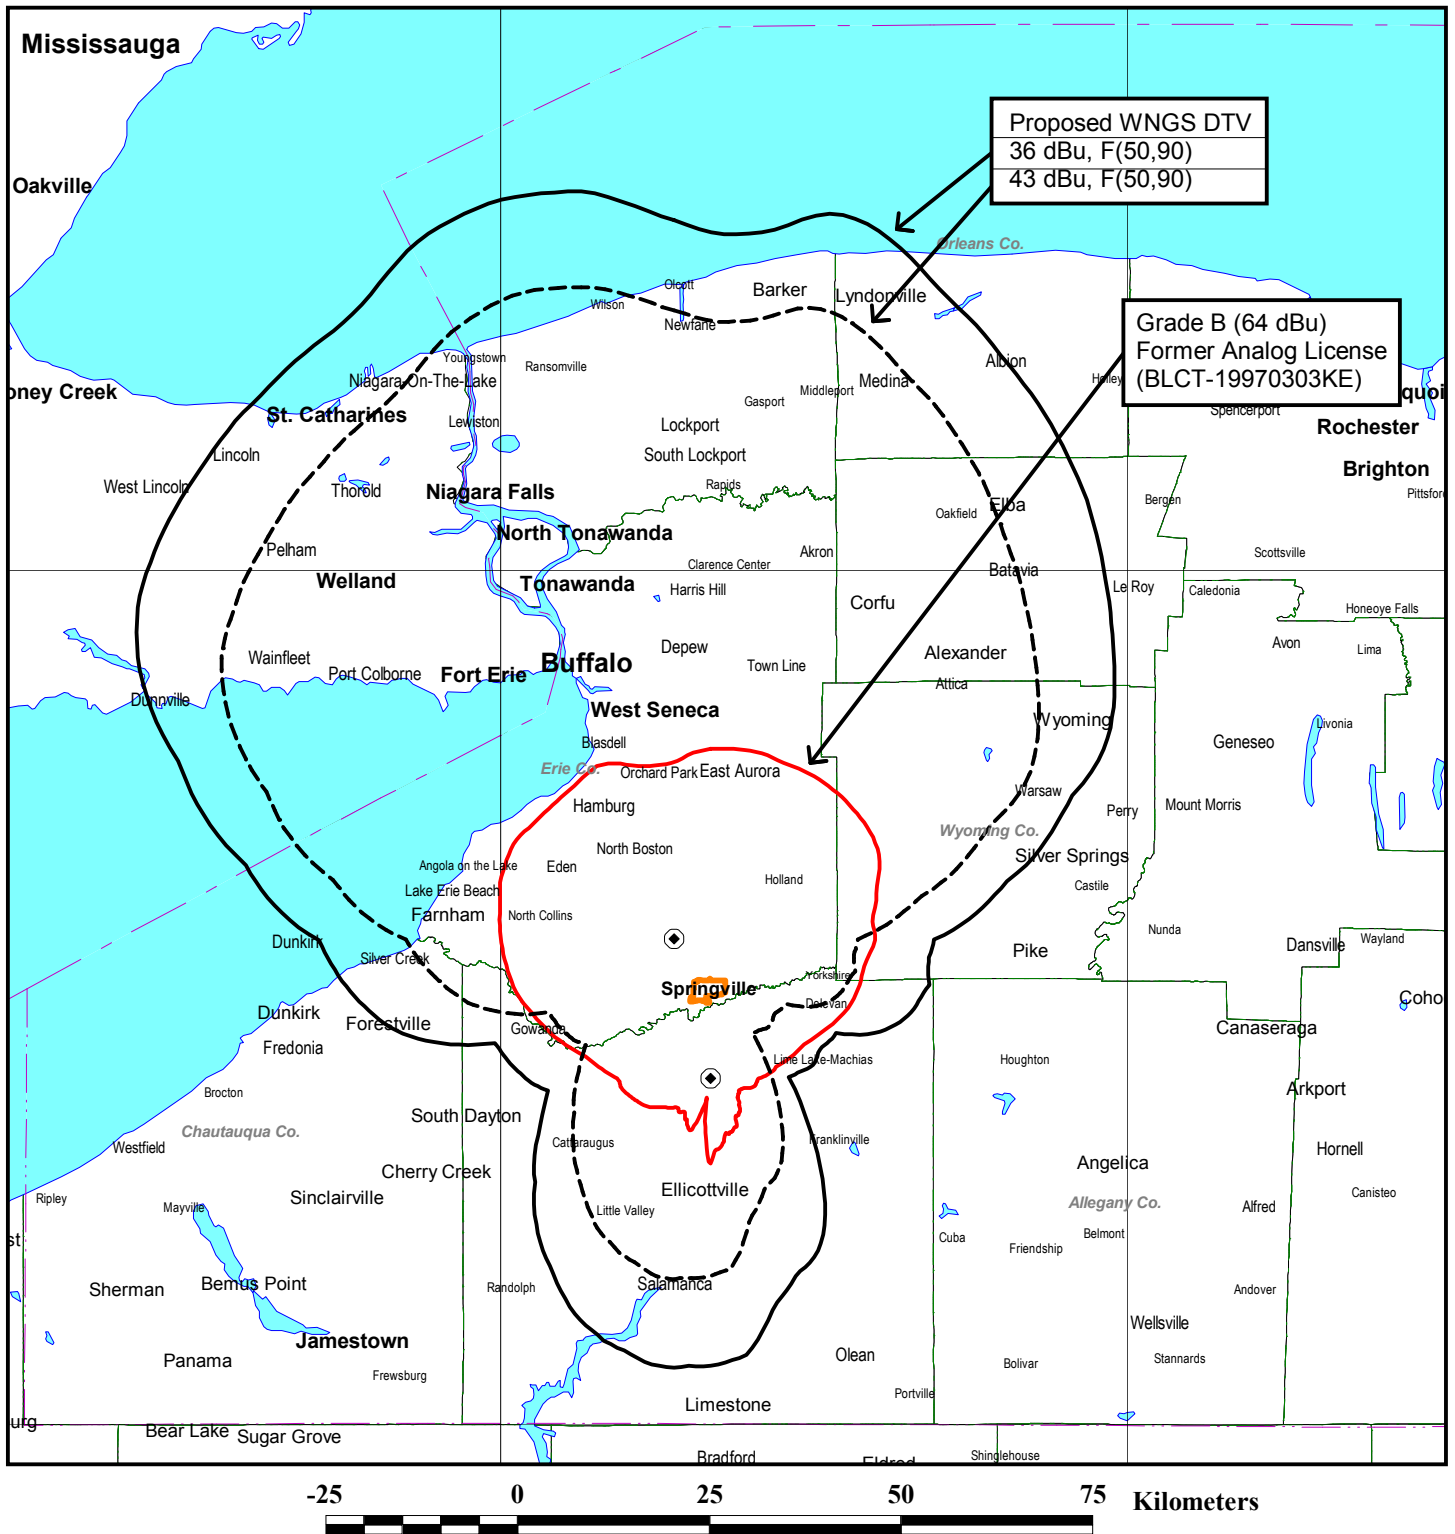

## FCC PREDICTED COVERAGE CONTOURS

DTV STATION WNGS  
 SPRINGVILLE, NEW YORK  
 CH 7 26.9 KW (MAX-DA) 176 M

du Treil, Lundin & Rackley, Inc. Sarasota, Florida