


3 Scala CL-FM(V)

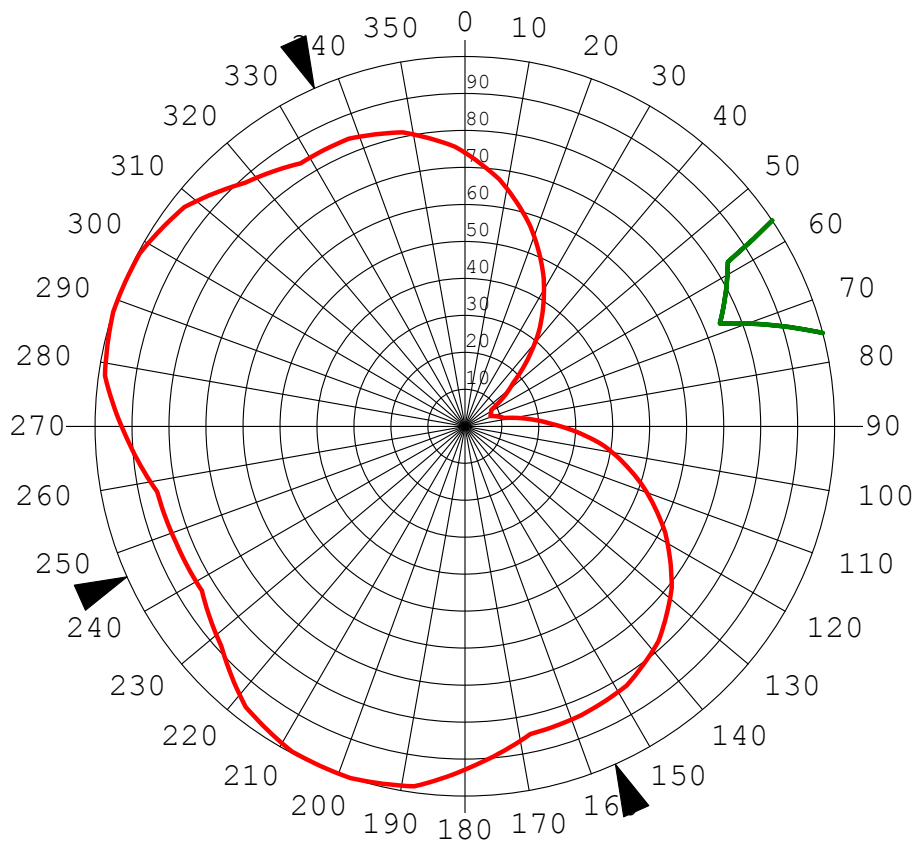

Azi	Rel	dBk	kW	dB
0	0.740	-5.35	0.292	-2.62
10	0.653	-6.43	0.227	-3.70
20	0.547	-7.97	0.159	-5.24
30	0.428	-10.11	0.097	-7.38
40	0.295	-13.35	0.046	-10.61
50	0.157	-18.80	0.013	-16.07
60	0.082	-24.46	0.004	-21.73
70	0.081	-24.53	0.004	-21.80
80	0.133	-20.24	0.009	-17.51
90	0.260	-14.45	0.036	-11.71
100	0.404	-10.59	0.087	-7.86
110	0.523	-8.36	0.146	-5.62
120	0.633	-6.71	0.213	-3.98
130	0.724	-5.54	0.279	-2.80
140	0.791	-4.77	0.333	-2.04
150	0.829	-4.36	0.366	-1.63
160	0.844	-4.21	0.379	-1.48
170	0.863	-4.01	0.397	-1.28

Azi	Rel	dBk	kW	dB
180	0.928	-3.38	0.459	-0.65
190	0.986	-2.85	0.519	-0.12
200	0.999	-2.74	0.532	-0.01
210	0.989	-2.83	0.521	-0.10
220	0.947	-3.20	0.478	-0.47
230	0.877	-3.87	0.410	-1.14
240	0.839	-4.25	0.375	-1.52
250	0.844	-4.21	0.379	-1.48
260	0.863	-4.01	0.397	-1.28
270	0.928	-3.38	0.459	-0.65
280	0.986	-2.85	0.519	-0.12
290	0.999	-2.74	0.532	-0.01
300	0.989	-2.83	0.521	-0.10
310	0.947	-3.20	0.478	-0.47
320	0.877	-3.87	0.410	-1.14
330	0.839	-4.26	0.375	-1.53
340	0.833	-4.32	0.370	-1.58
350	0.801	-4.66	0.342	-1.92

Rotation Angle = 0