


Figure 1

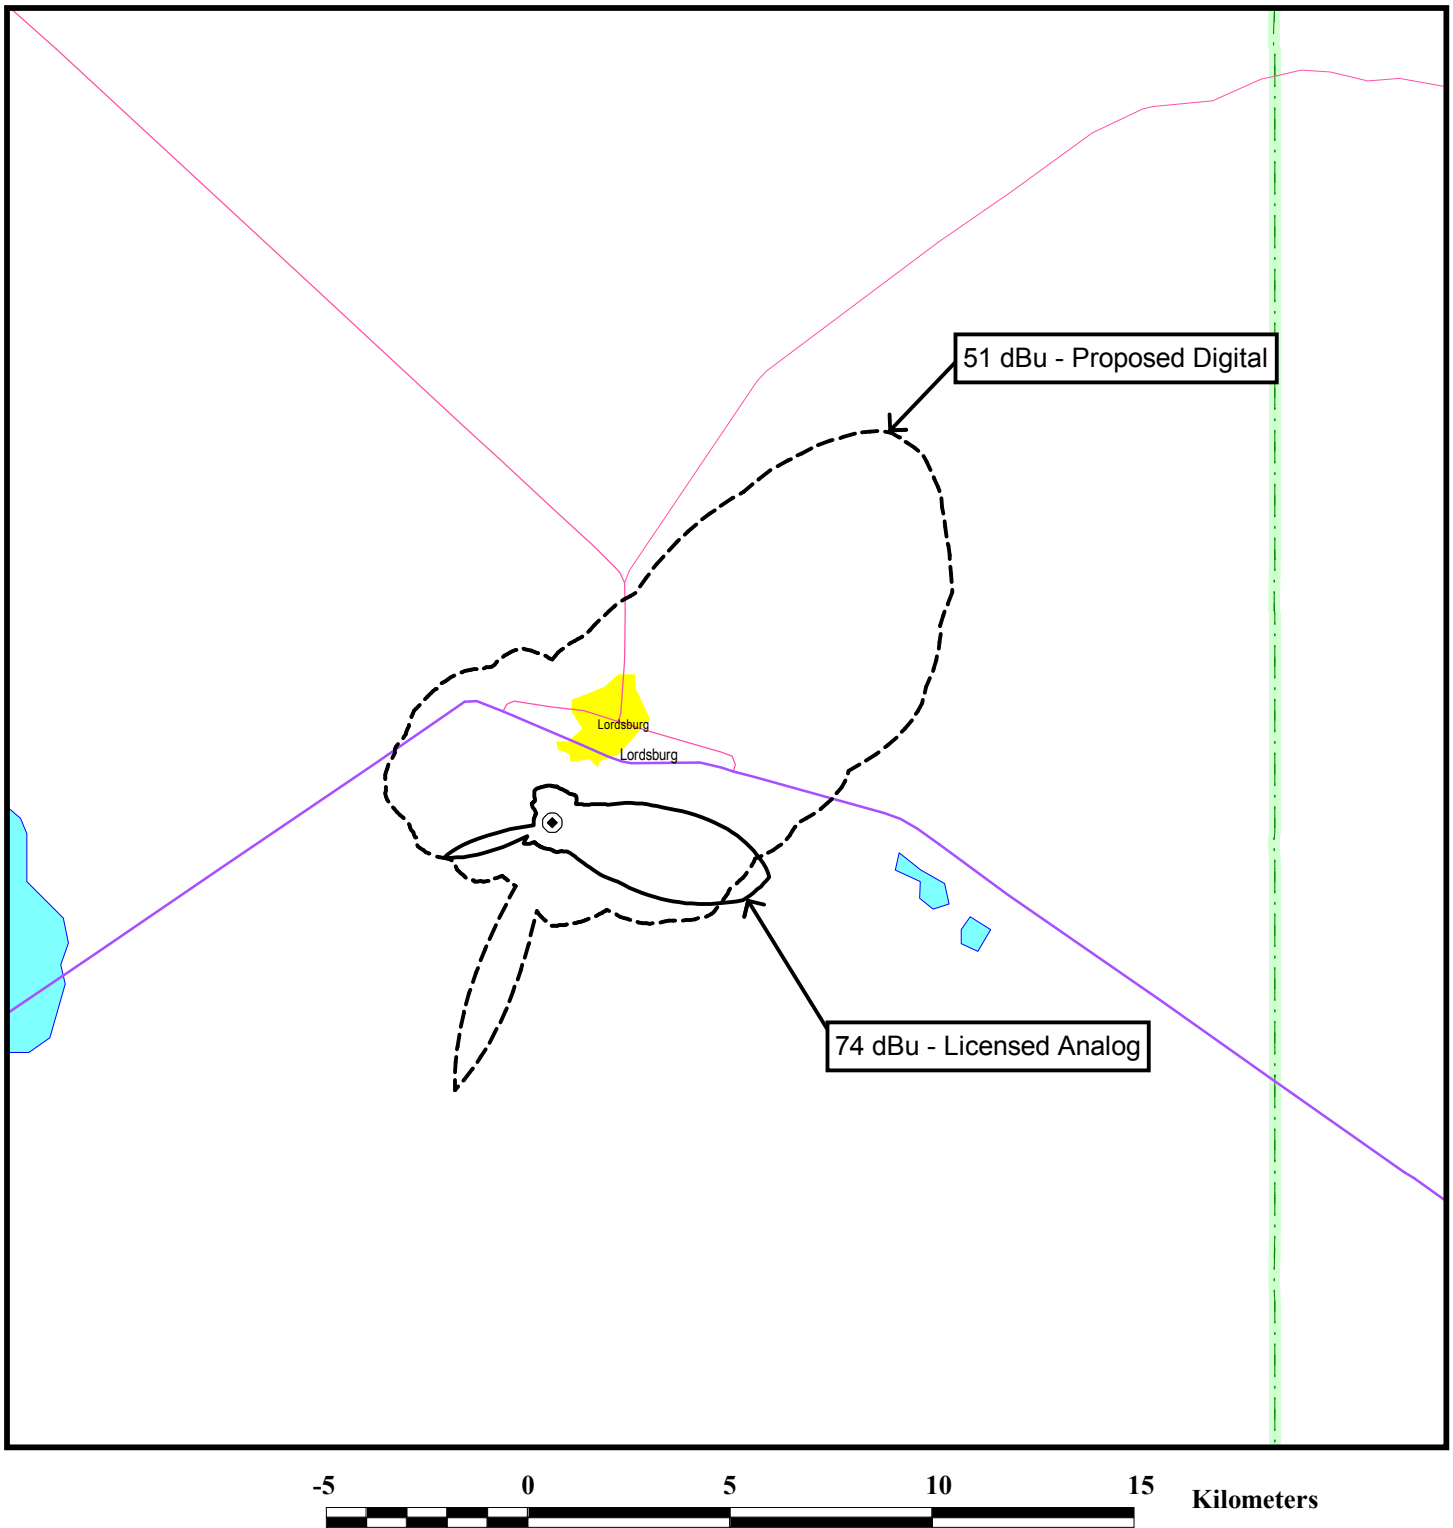

FCC PREDICTED COVERAGE CONTOURS

TRANSLATOR STATION K40HJ
LORDSBURG, NEW MEXICO
CH 16 0.3 KW (MAX-DA)

du Treil, Lundin & Rackley, Inc. Sarasota, Florida