


Figure 1

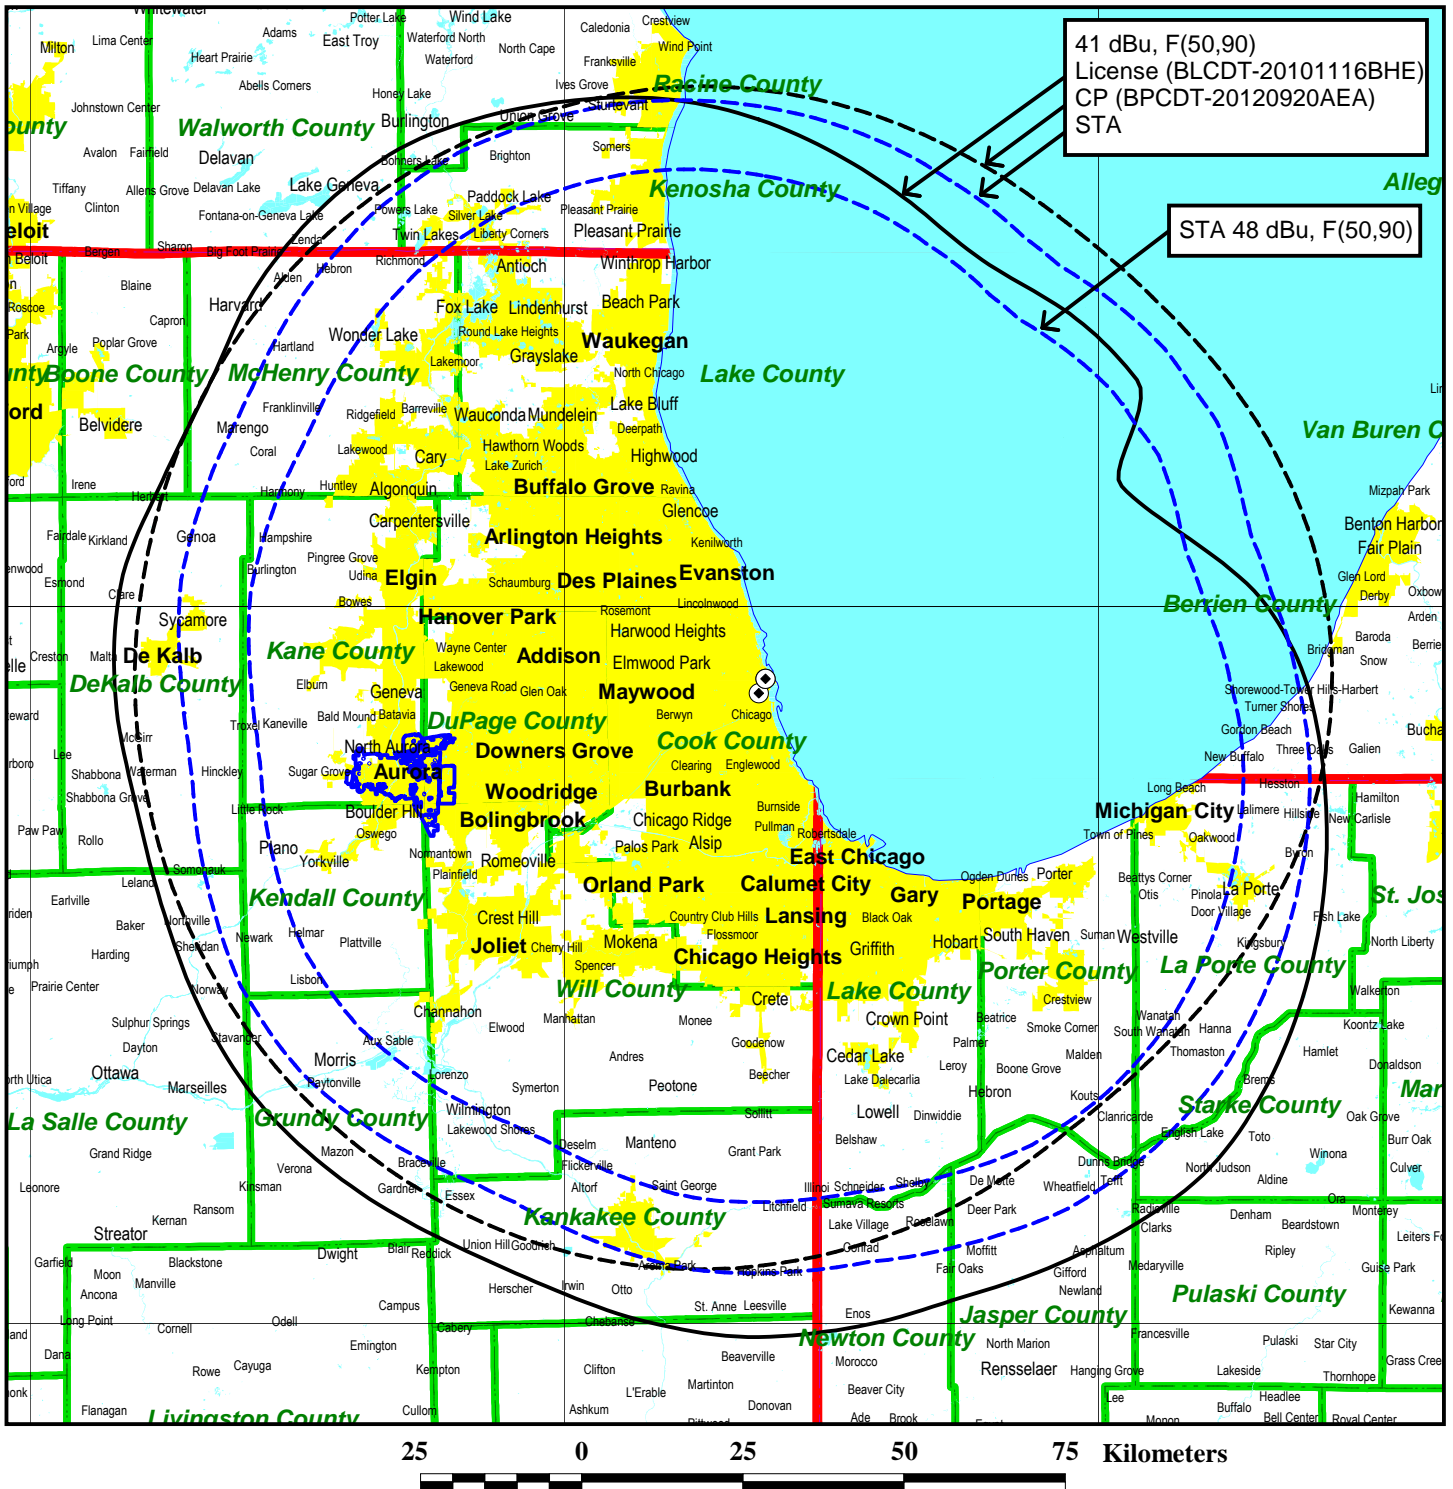

FCC PREDICTED COVERAGE CONTOURS

PROPOSED STA
STATION WXFT-DT
AURORA, ILLINOIS

CH 50 190 KW (MAX-DA) 438 M

du Treil, Lundin & Rackley, Inc. Sarasota, Florida