


Figure 1

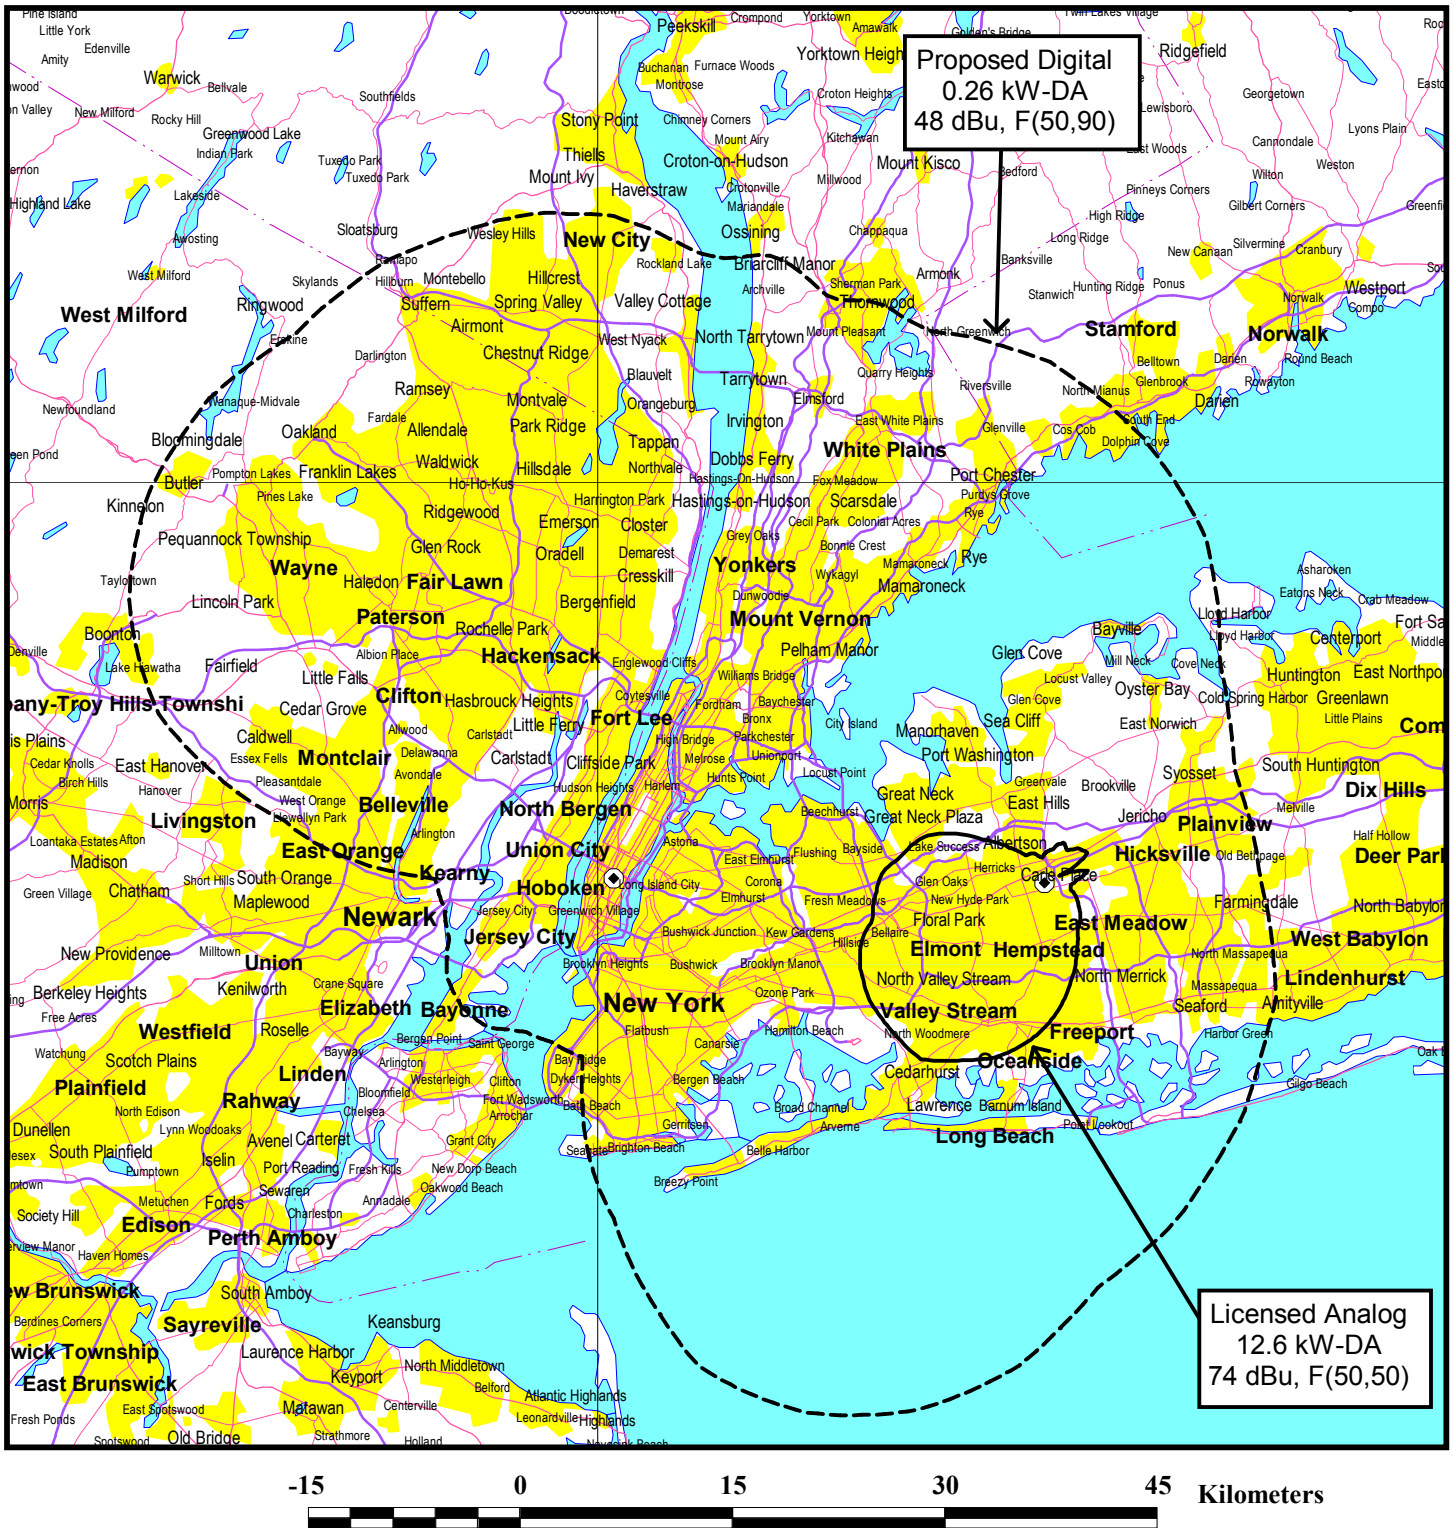

PREDICTED COVERAGE CONTOURS

STATION WPXU-LP
AMITYVILLE, NEW YORK
CH 12 0.26 KW (MAX-DA)

du Treil, Lundin & Rackley, Inc. Sarasota, Florida 34237