


Figure 2

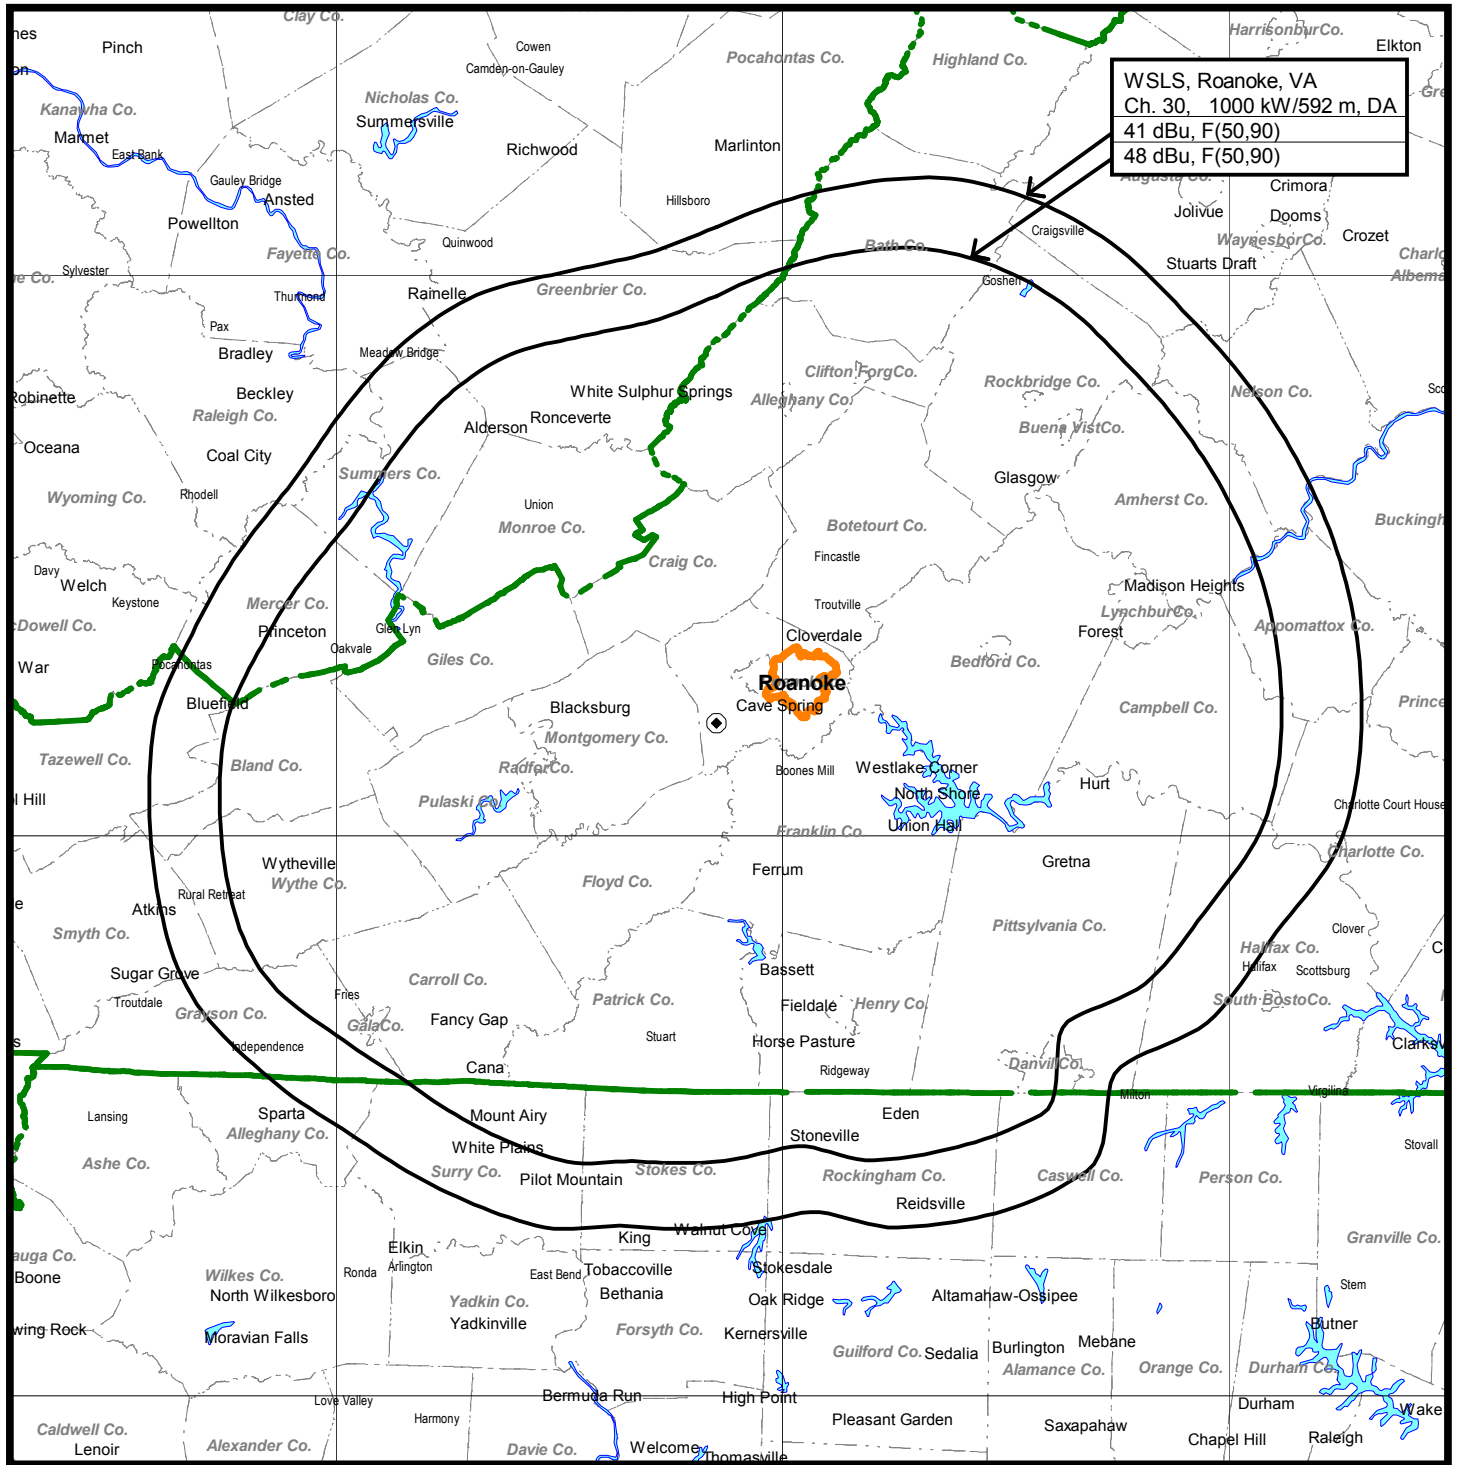

WSLS, Roanoke, VA
Ch. 30, 1000 kW/592 m, DA
41 dBu, F(50,90)
48 dBu, F(50,90)

FCC PREDICTED COVERAGE CONTOURS

STATION WSLs-DT
ROANOKE, VIRGINIA
CH 30 1000 KW-DA 592 M

du Treil, Lundin & Rackley, Inc. Sarasota, Florida