


Figure 2

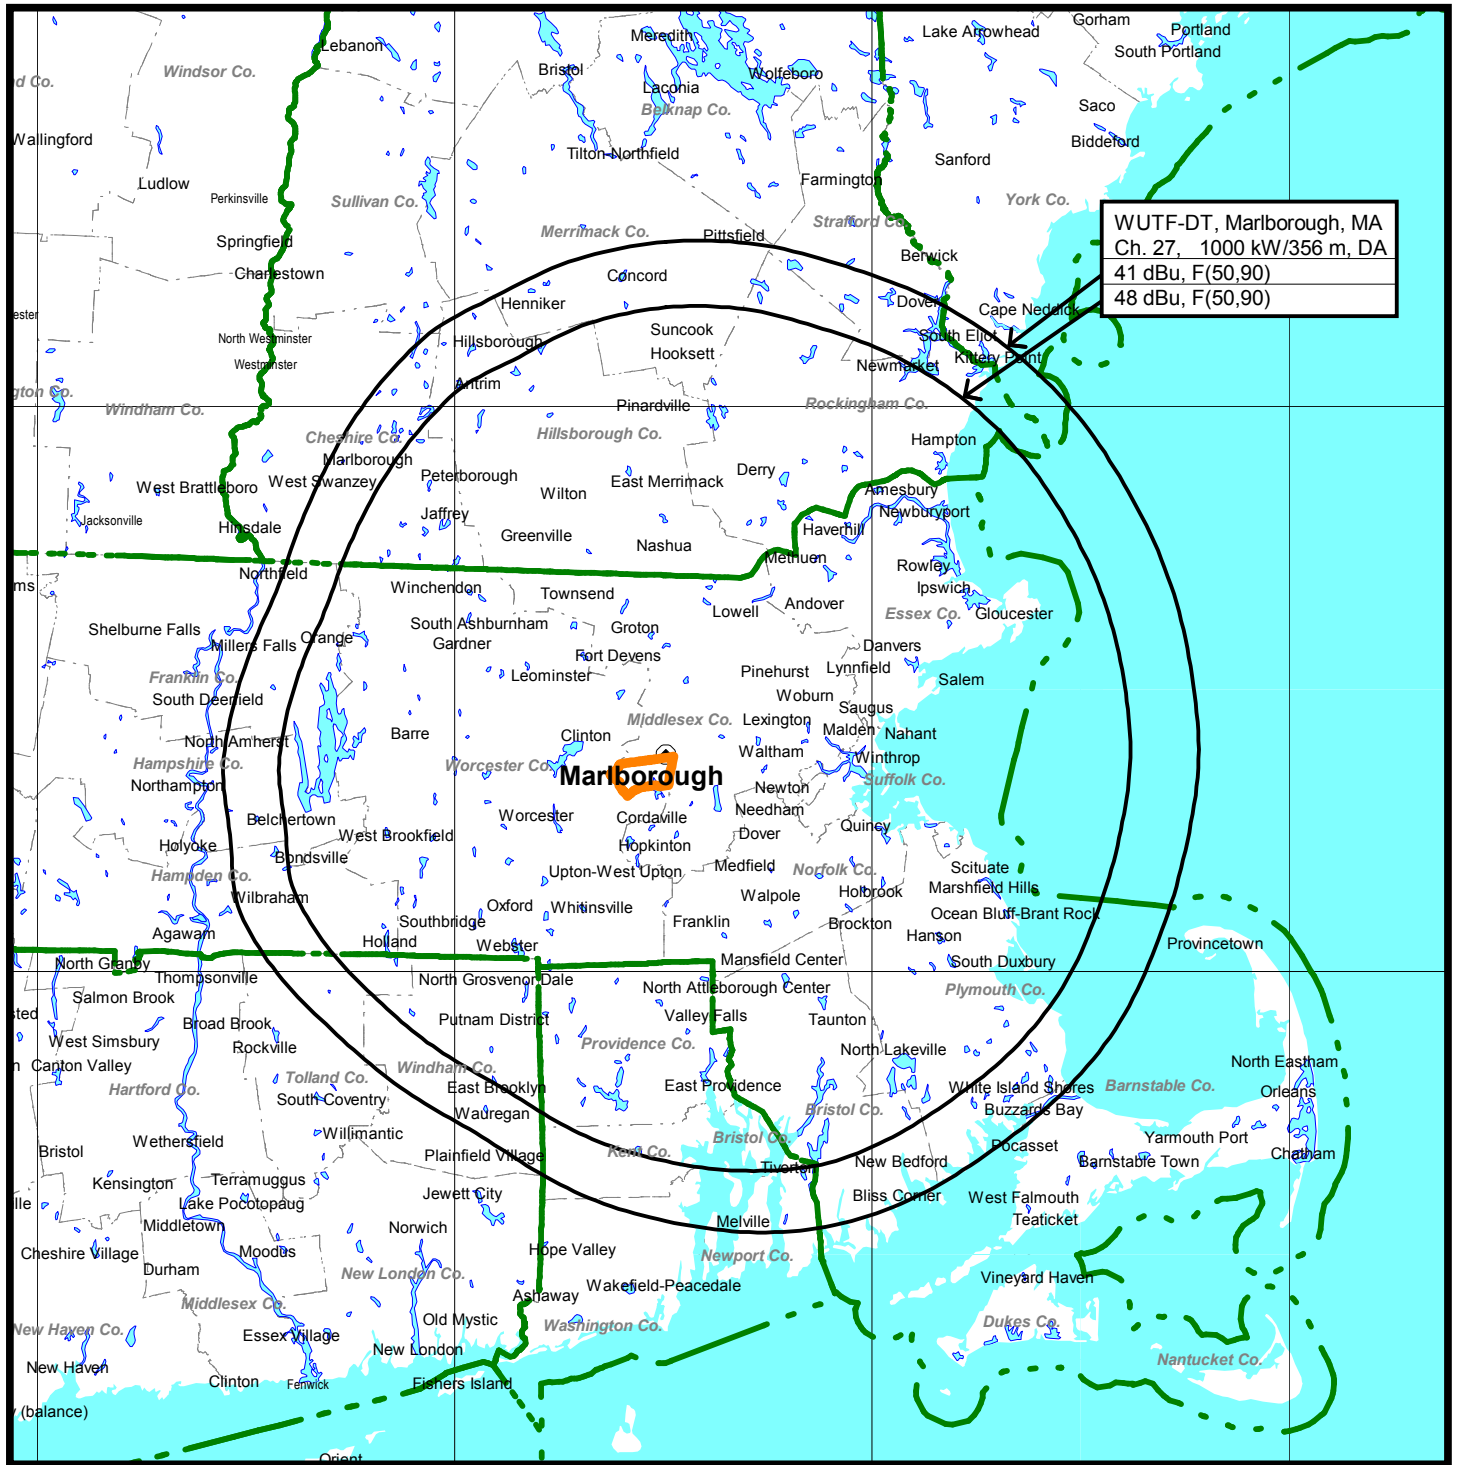

WUTF-DT, Marlborough, MA
Ch. 27, 1000 kW/356 m, DA
41 dBu, F(50,90)
48 dBu, F(50,90)

FCC PREDICTED COVERAGE CONTOURS

STATION WUTF-DT
MARLBOROUGH, MASSACHUSETTS
CH 27 1000 KW (MAX-DA) 356 M

du Treil, Lundin & Rackley, Inc. Sarasota, Florida