


Figure 6

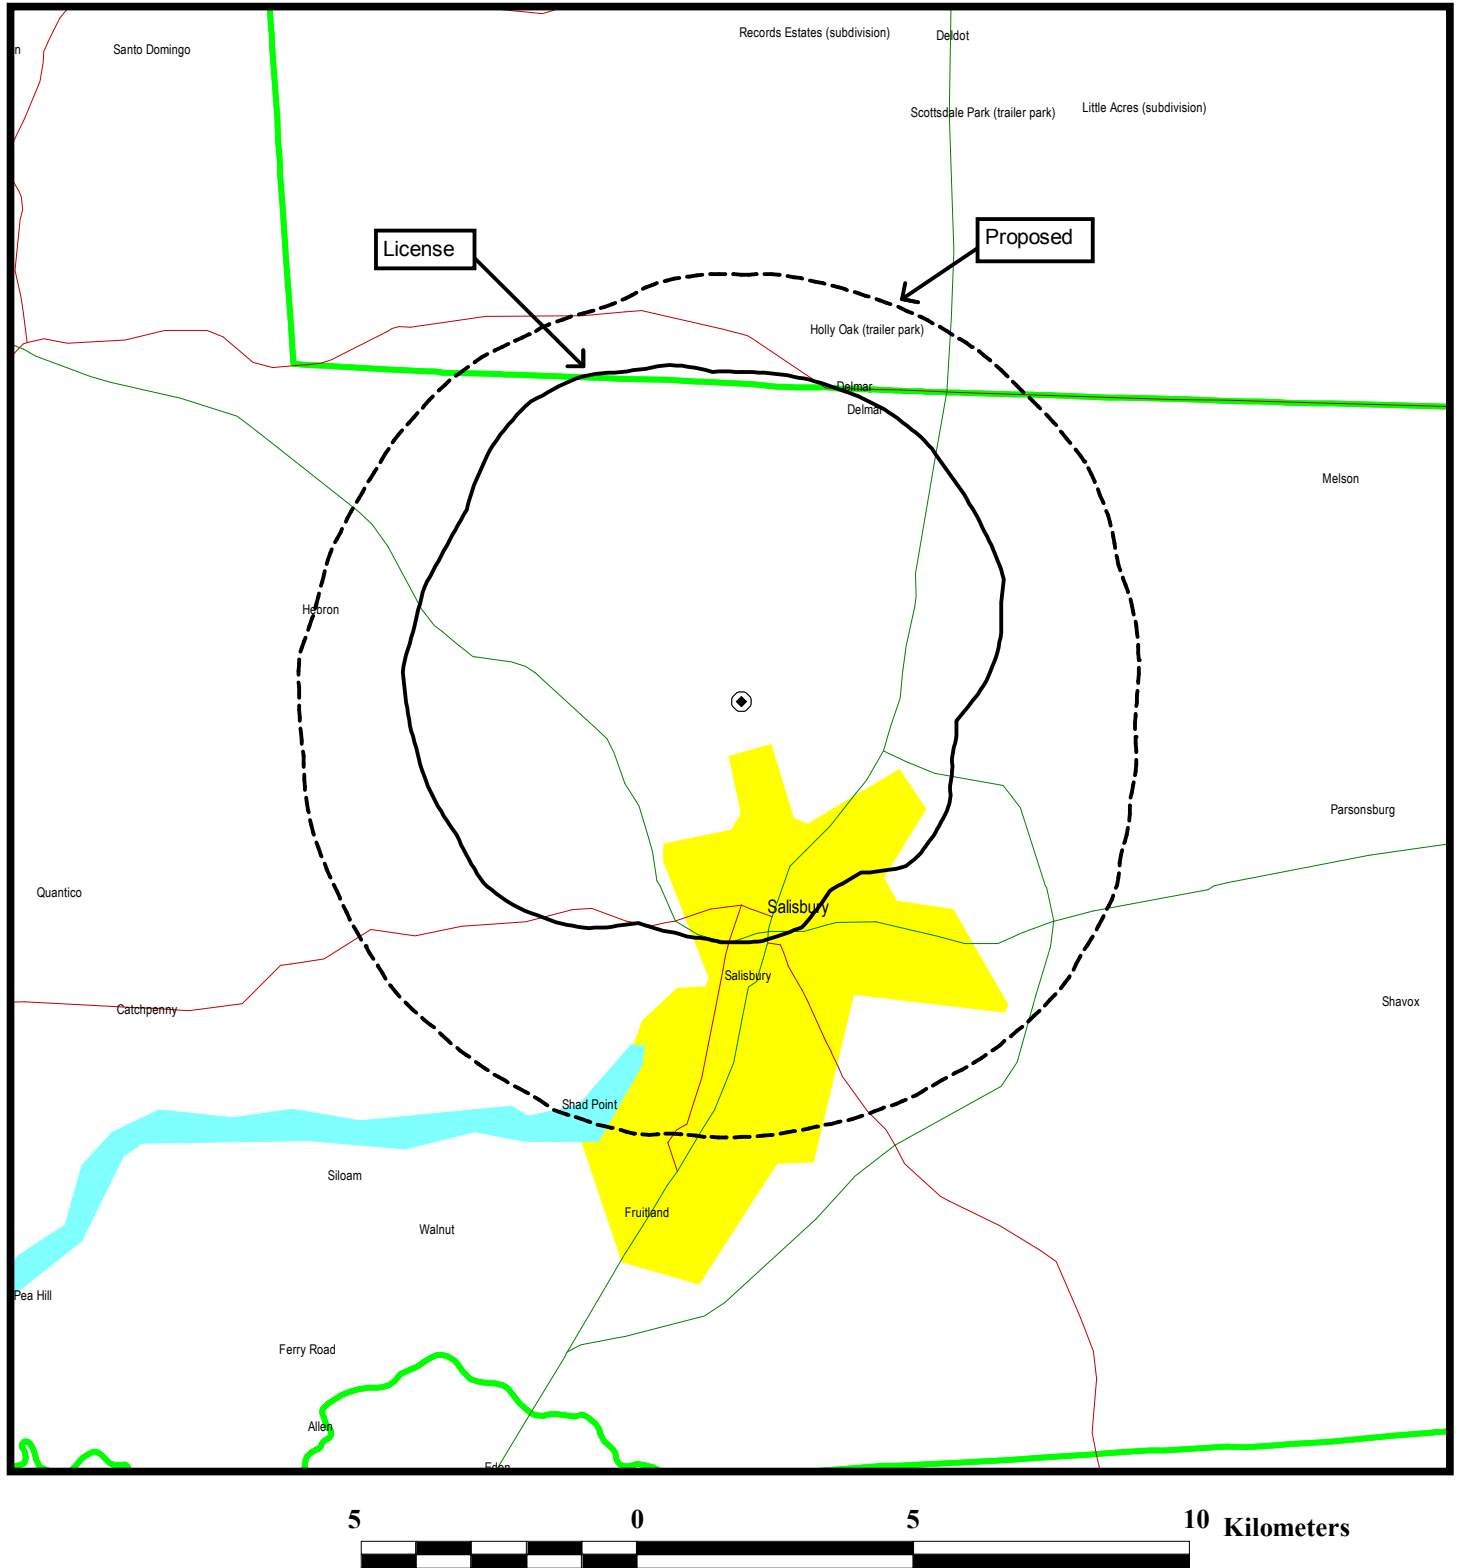

**FCC PREDICTED 60 DBU CONTOURS
STATION W204AY
SALISBURY, MARYLAND
CH 210 0.1 KW**

du Treil, Lundin & Rackley, Inc. Sarasota, Florida