


Figure 3

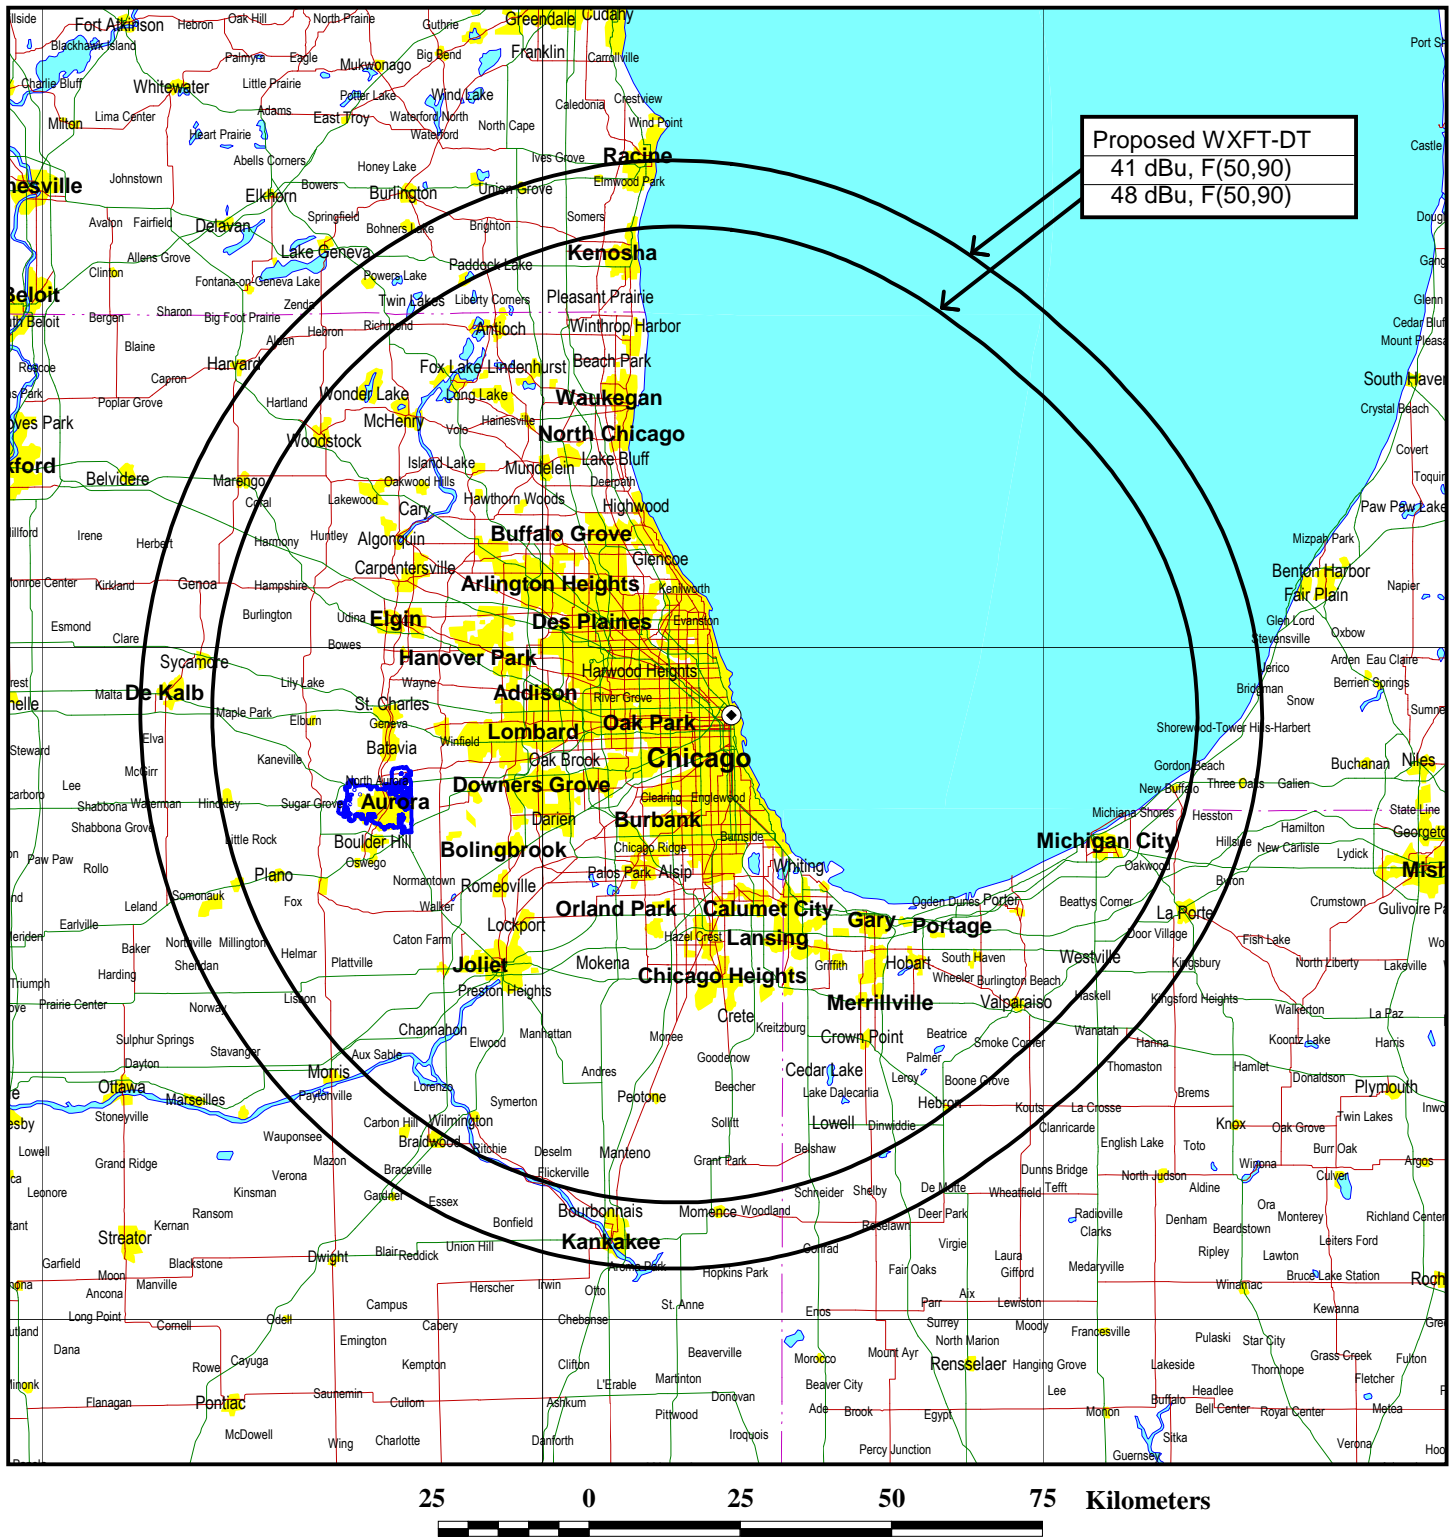

FCC PREDICTED COVERAGE CONTOURS

STATION WXFT-DT
 AURORA, ILLINOIS
 CH 50 365 KW (MAX-DA) 417 M

du Treil, Lundin & Rackley, Inc. Sarasota, Florida