

Exhibit 12

Interference Analysis Overlap Requirements

According to CFR 47 §74.1204(a), translators are required to protect all existing FM stations from interference due to overlap of the protected contours of the existing stations with the interfering contours of the new translators.

US Stations

In the attached tabular printout, no entries have outgoing contour overlaps from the proposed translator, so no interference along the line between stations is anticipated. Incoming overlap is not prohibited.

The outgoing overlap to WATDFM is sufficiently small that a map was prepared to certify that no prohibited contour overlap occurs at any azimuth.

The AP243s are the same facility as the proposal and need not be protected.

No other entry is close enough to require further analysis.

IF Separation

No stations separated by 53 or 54 channels were found by the search.


Exhibit 12
MA Plymouth

REFERENCE	CH# 241D - 96.1 MHz, Pwr= 0.003 kW, HAAT=69.8 M, COR= 70 M	DISPLAY DATES
41 51 00 N	Average Protected F(50-50)= 3.57 km	DATA 05-29-04
70 34 31 W	Ave. F(50-10) 40 dBu= 11.4 54 dBu= 5.1 80 dBu= 1.2 100 dBu= .1	SEARCH 07-05-04

CH CITY	CALL	TYPE STATE	AZI. <--	DIST FILE #	LAT. LNG.	Pwr (kW) HAAT (M)	COR (M) INT (km)	PRO (km) LICENSEE	*IN* (Overlap in km)	*OUT*
240A Marshfield	WATDFM	LIC C MA	339.8 159.8	30.89 BLH19990305KC	42 06 39 70 42 17	1.600 163	166 39.3	26.1 Marshfield Broadcasting Co	-11.65<	0.20
243D Plymouth	AP243	APP C MA	354.5 174.5	9.36 BNPFT20030829AGH	41 56 02 70 35 10	0.006 172	201 0.2	6.7 Living Proof, Inc.	6.50	2.57
243D Plymouth	AP243	APP C MA	354.5 174.5	9.36 BNPFT20030312ABU	41 56 02 70 35 10	0.006 172	201 0.2	6.7 Living Proof, Inc.	6.50	2.57
241B Worcester Proposed to Canada	WSRS«	LIC CN MA as Class C1	295.4 115.4 950126-Accepted by Canada	121.19 BLH19930528KC 950331	42 18 34 71 54 13 950331	16.500 331	503 134.6	70.4 Capstar Tx Limited Partner	-15.84<	40.00
242B Nantucket	WRZE«	LIC CX MA	151.8 331.8	71.73 BLH20021203AAY	41 16 50 70 10 10	50.000 132	132 75.3	62.5 Qantum Of Cape Cod License	-6.46<	3.57
238B Providence	WBRU	LIC C RI	268.1 88.1	65.99 BLH19990723KD	41 49 40 71 22 09	18.500 144	170 4.4	54.8 Brown Broadcasting Service	58.82	10.93
243D New Bedford	AP243	APP C MA	235.6 55.6	43.50 BNPFT20030317LBB	41 37 43 71 00 24	0.019 98	116 0.3	6.7 Emerson College	39.98	36.63
243D New Bedford	AP243	APP C MA	235.6 55.6	43.50 BNPFT20030820ADS	41 37 43 71 00 24	0.019 93	111 0.3	6.6 Emerson College	39.98	36.82

ERP and HAAT are on direct line to and from reference station.

"«" = Station meets FCC minimum distance spacing for its class. "<" = Contour Overlap

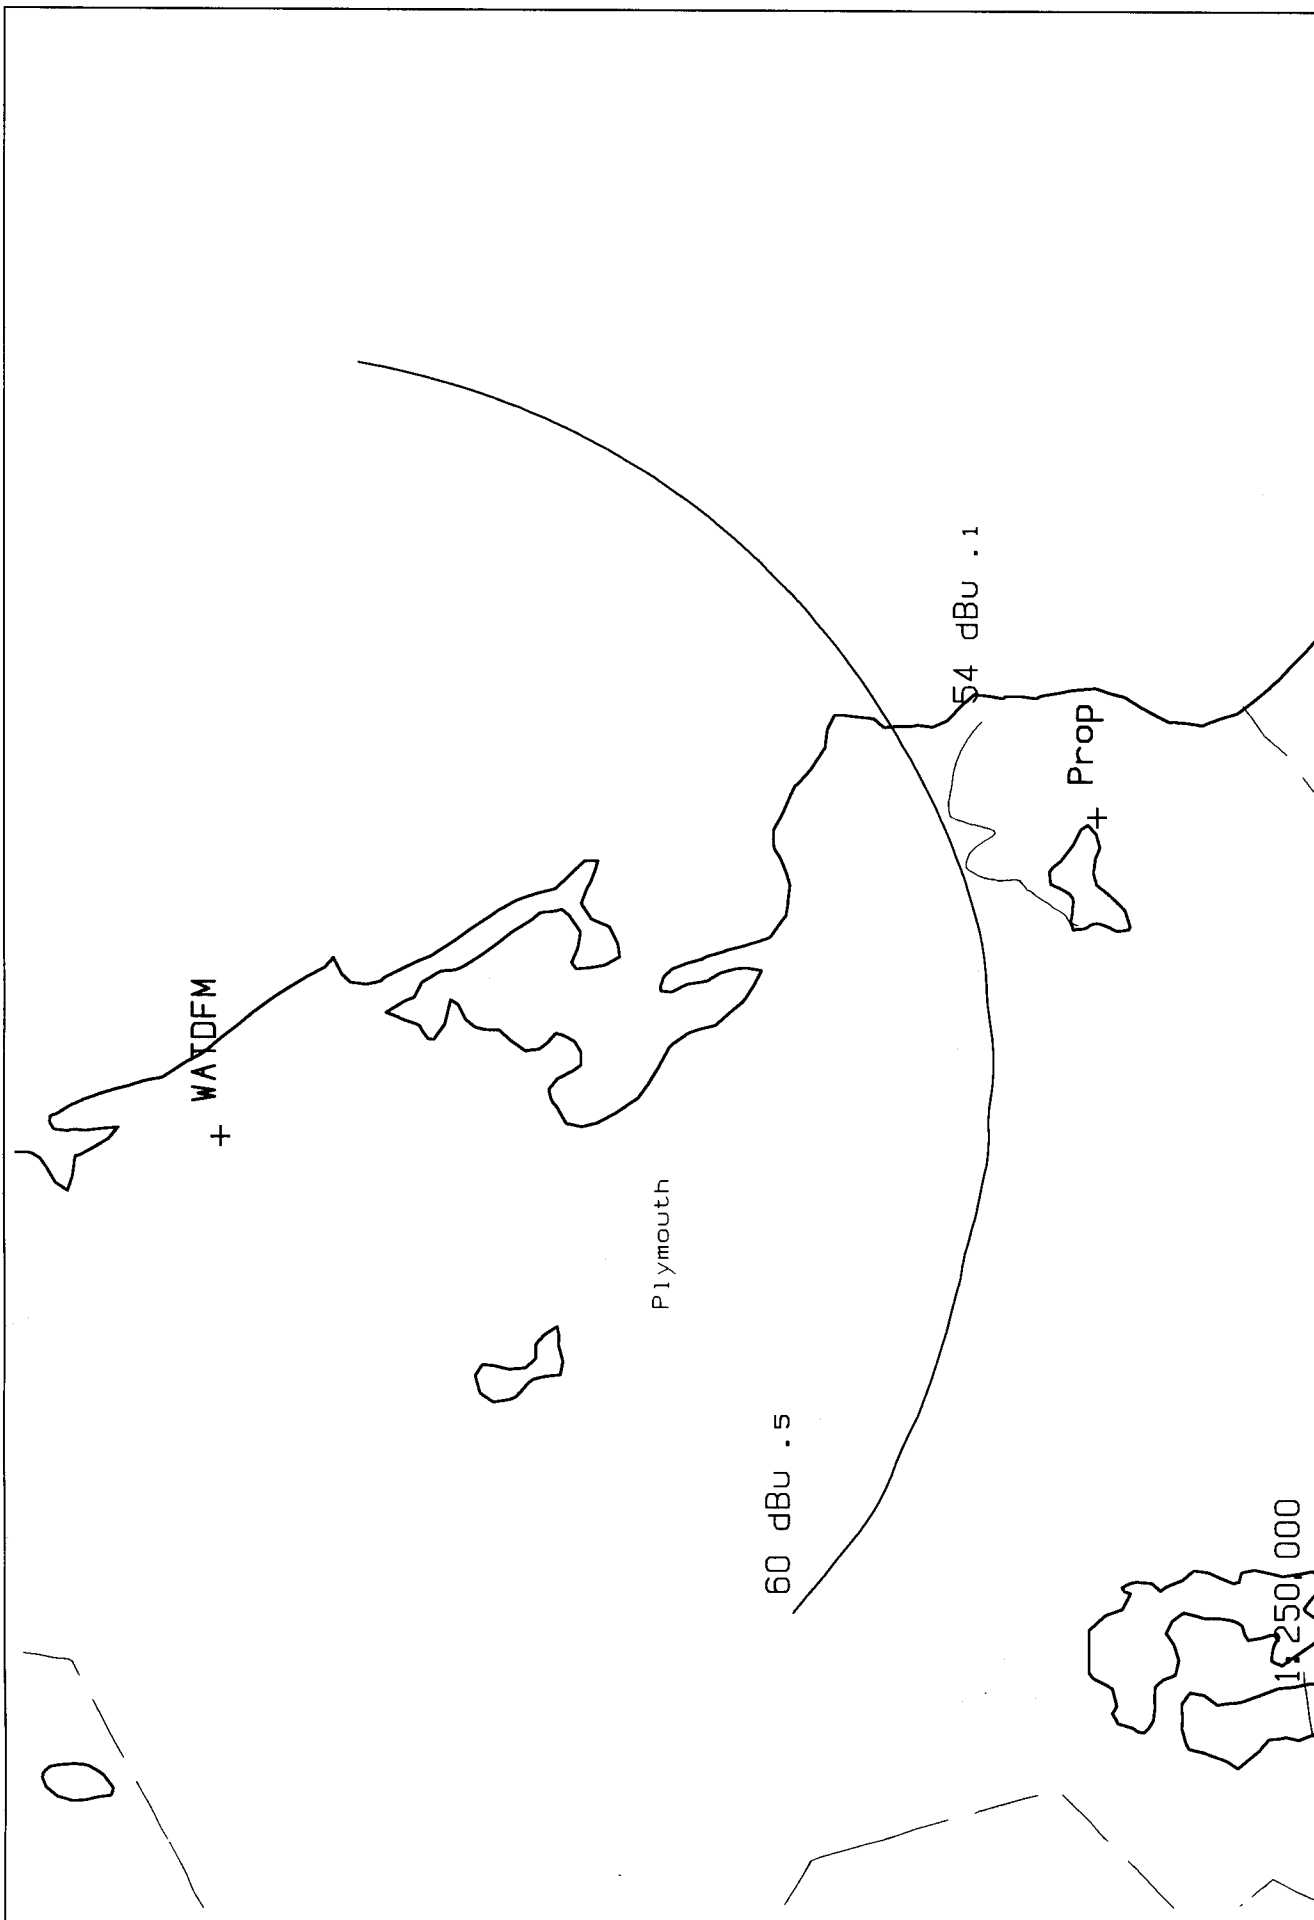

<p>WATDFM 240A 1.6kW 166M AMSL Prop 241D .003kW 70M AMSL</p>	<p>WATDFM vs Prop Bob Moore - 07/04</p>
-------------------------------------------------------------------	----------------------------------------------