


CH 267 L1 101.3 MHz
Current Spacings to 2nd Adj.

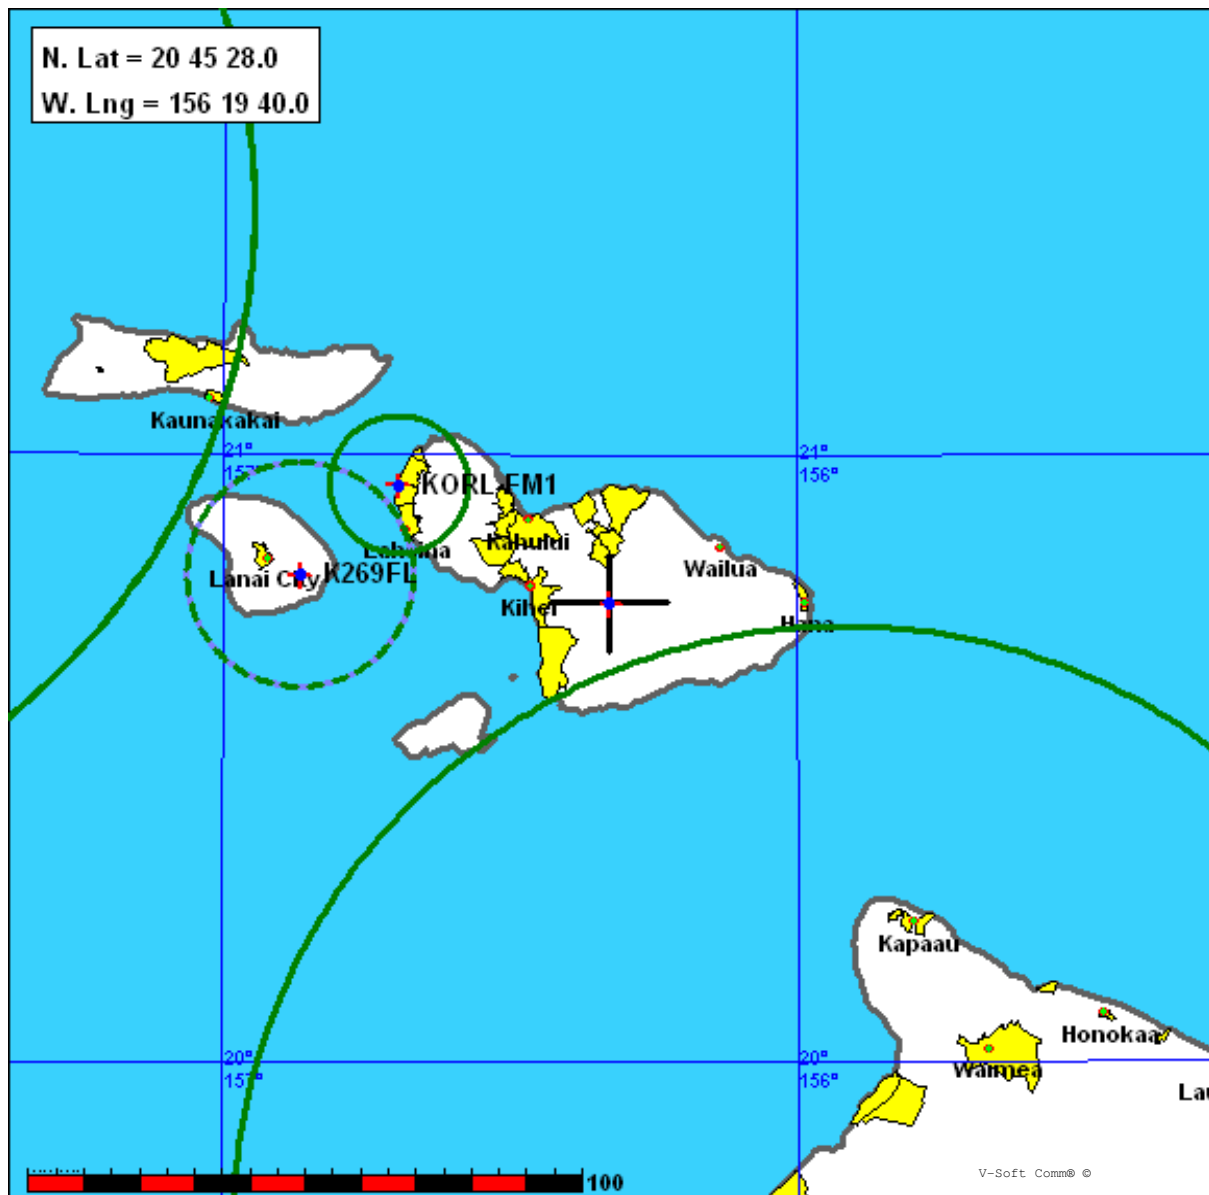

Data Date:08-26-13				Job Date:09-19-13					
Call	CH#	Type	Location	Azi	D-KM	FCC	Margin		
	Lat.		Lng. Ant	Power	HAAT				
KA0Y	268C0	LIC	Kealahakua	HI	159.7	122.40	110.5	11.9	
19 43	15.0	155	55 16.0	CX	6.500 kW		909 M		
KORL-FM1	266D	LIC	Lahaina	HI	299.6	43.73	12.5	31.2	
20 57	06.0	156	41 38.0	CN	0.980 kW		-107 M		
K269FL	269D	LIC-D	Kahului	HI	275.3	56.07	20.5	35.6	
20 48	12.0	156	51 51.0	DC	0.250 kW		838 M		
KORL-FM	266C	LIC-D	Waianae	HI	291.4	197.19	119.5	77.7	
21 23	45.0	158	05 58.0	DEX	100.000 kW		592 M		
AL9254	266C	RSV-A	Waianae	HI	291.5	197.34	119.5	77.8	
21 23	51.0	158	06 01.0		100.000 kW		600 M		

RSV-R, reserved, needs protection, RSV-A, allocation, does not if a CP or LIC has been granted.
All separation margins include rounding