

INTERFERENCE CONTOURS

PROPOSED KTXV


JEFFREY N. EUSTIS


90 KHz 2 kW/0.25 kW DA-2

FRANKSTON, TEXAS

MARCH 2002

EXHIBIT E-6E

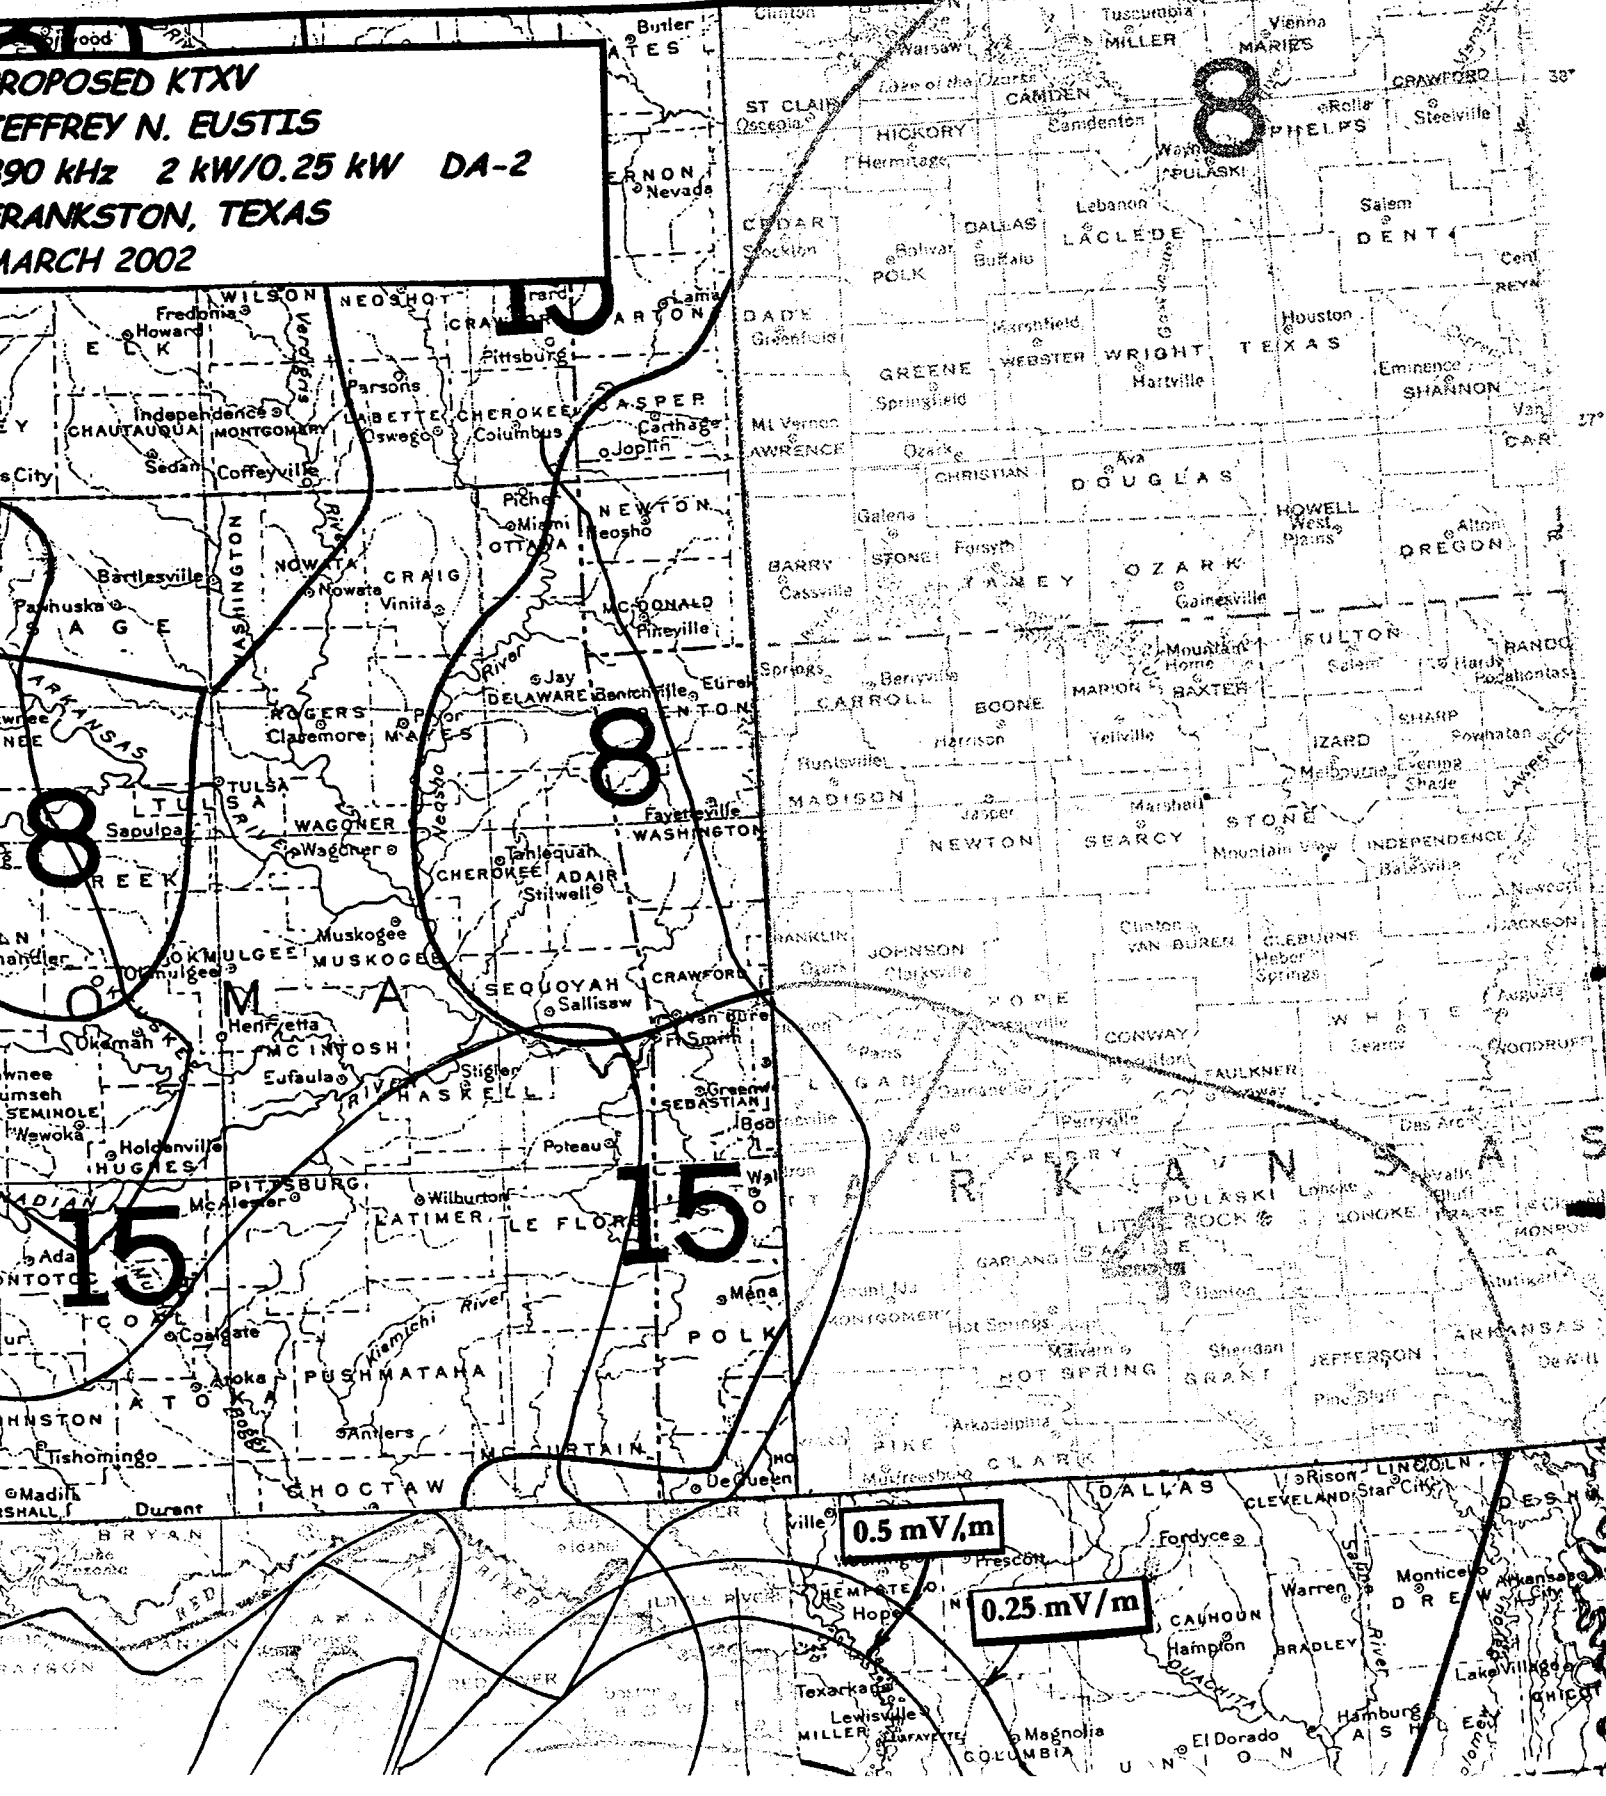


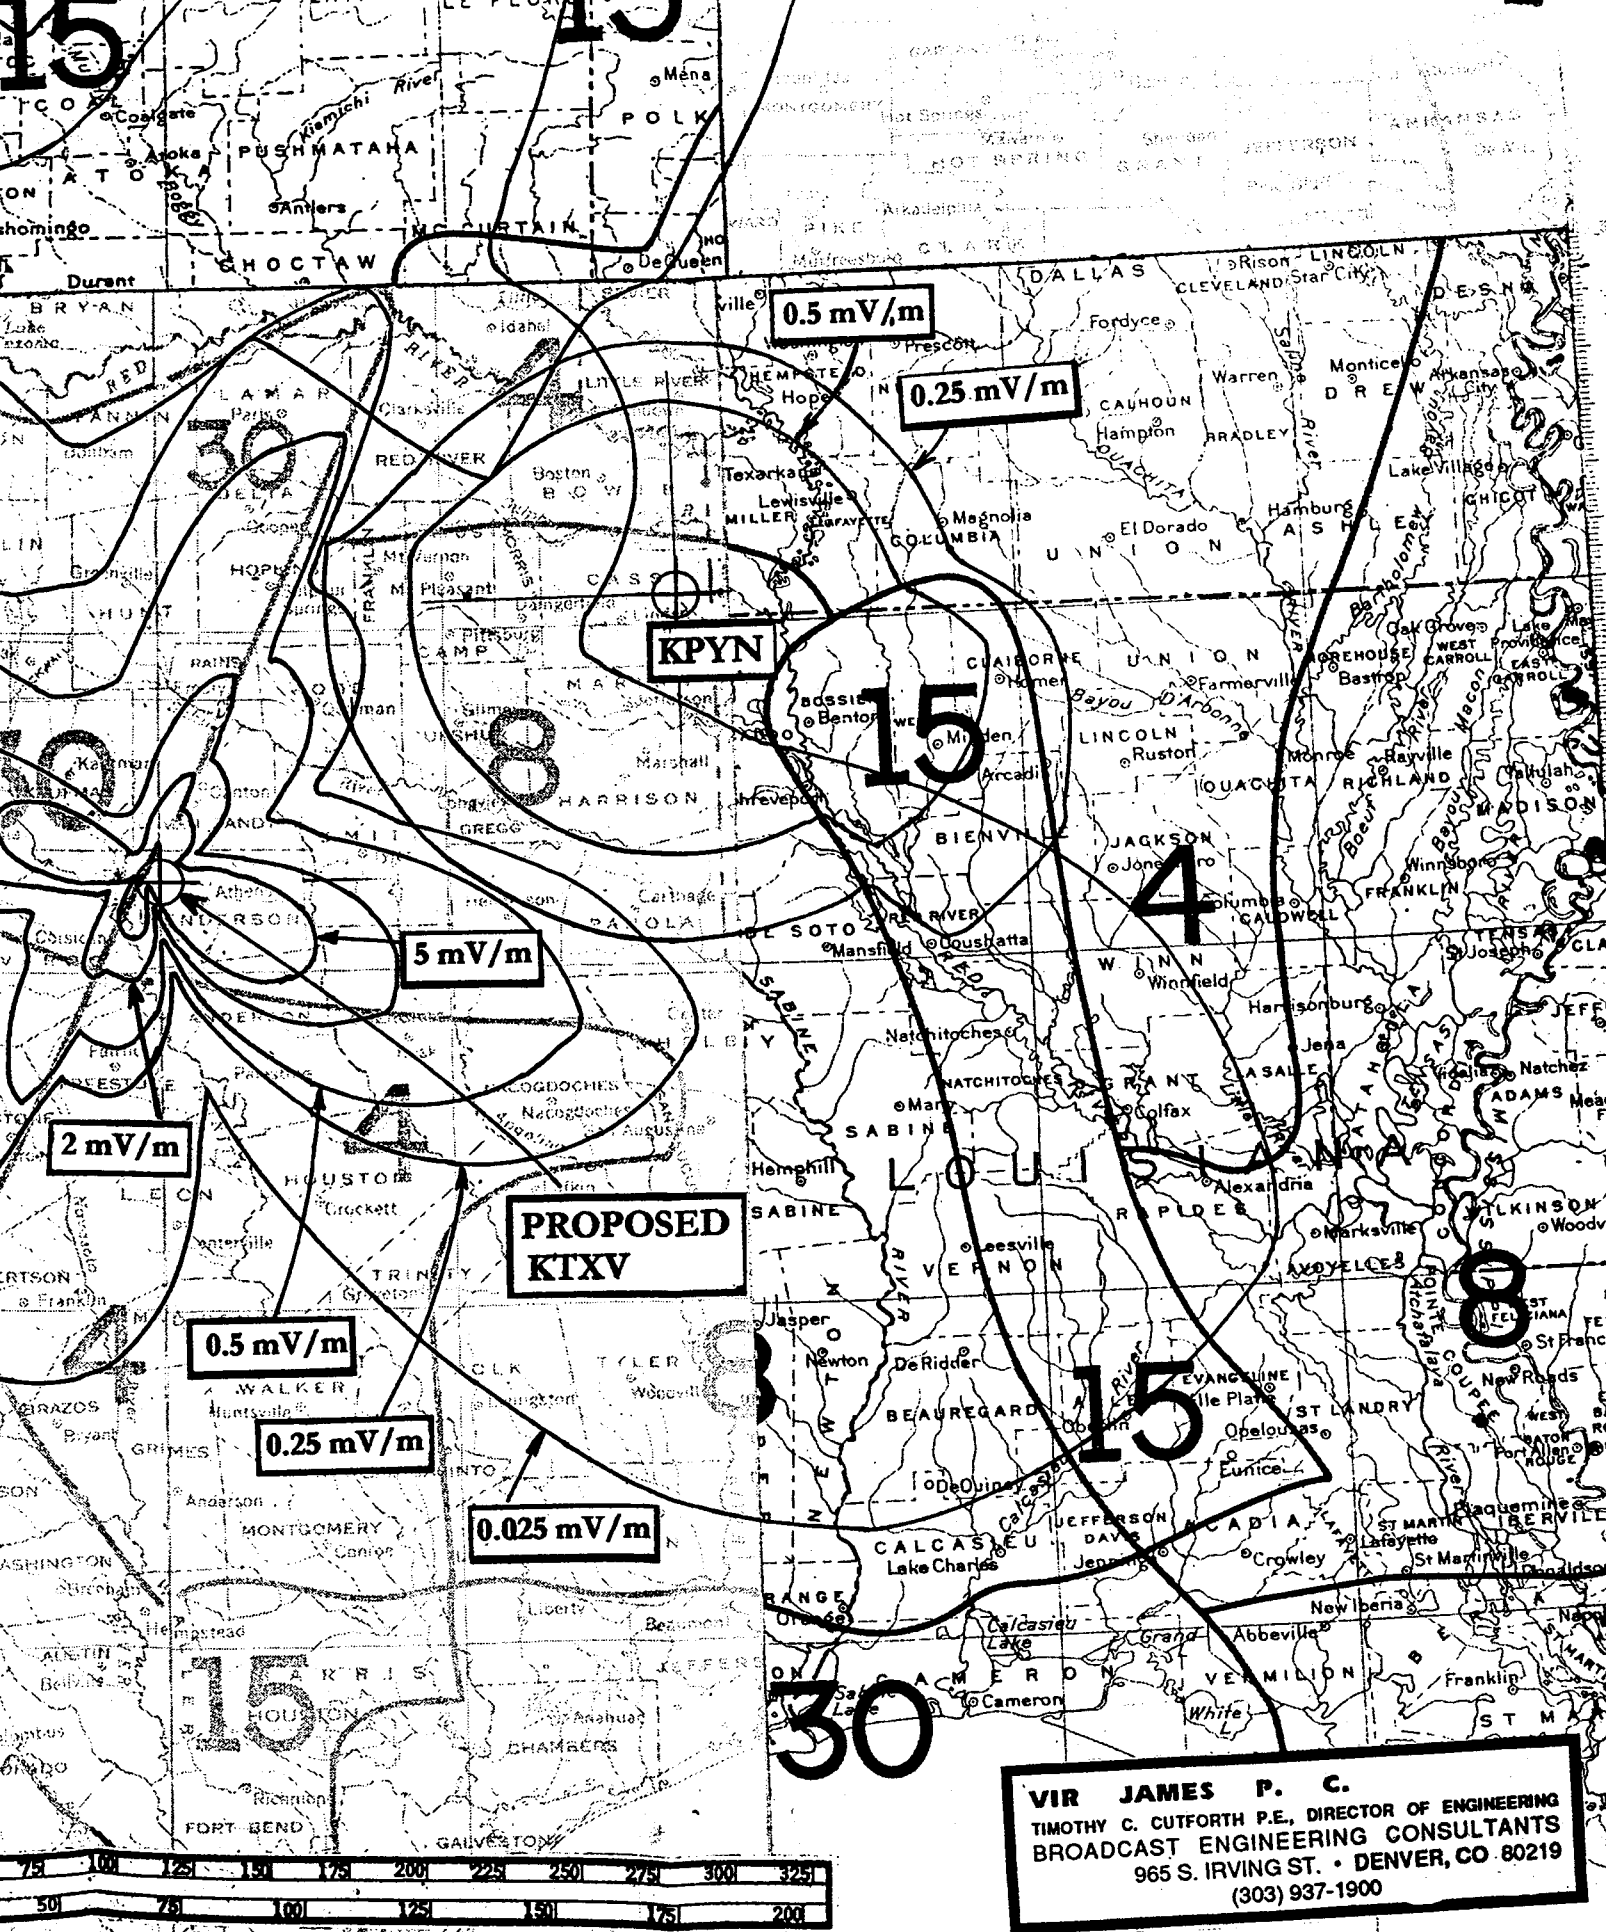


KPYN


PROPOSED
KTXV

VIR JAMES P. C.
TIMOTHY C. CUTFORTH P.E., DIRECTOR OF ENGINEERING
BROADCAST ENGINEERING CONSULTANTS
965 S. IRVING ST. • DENVER, CO 80219
(303) 937-1900

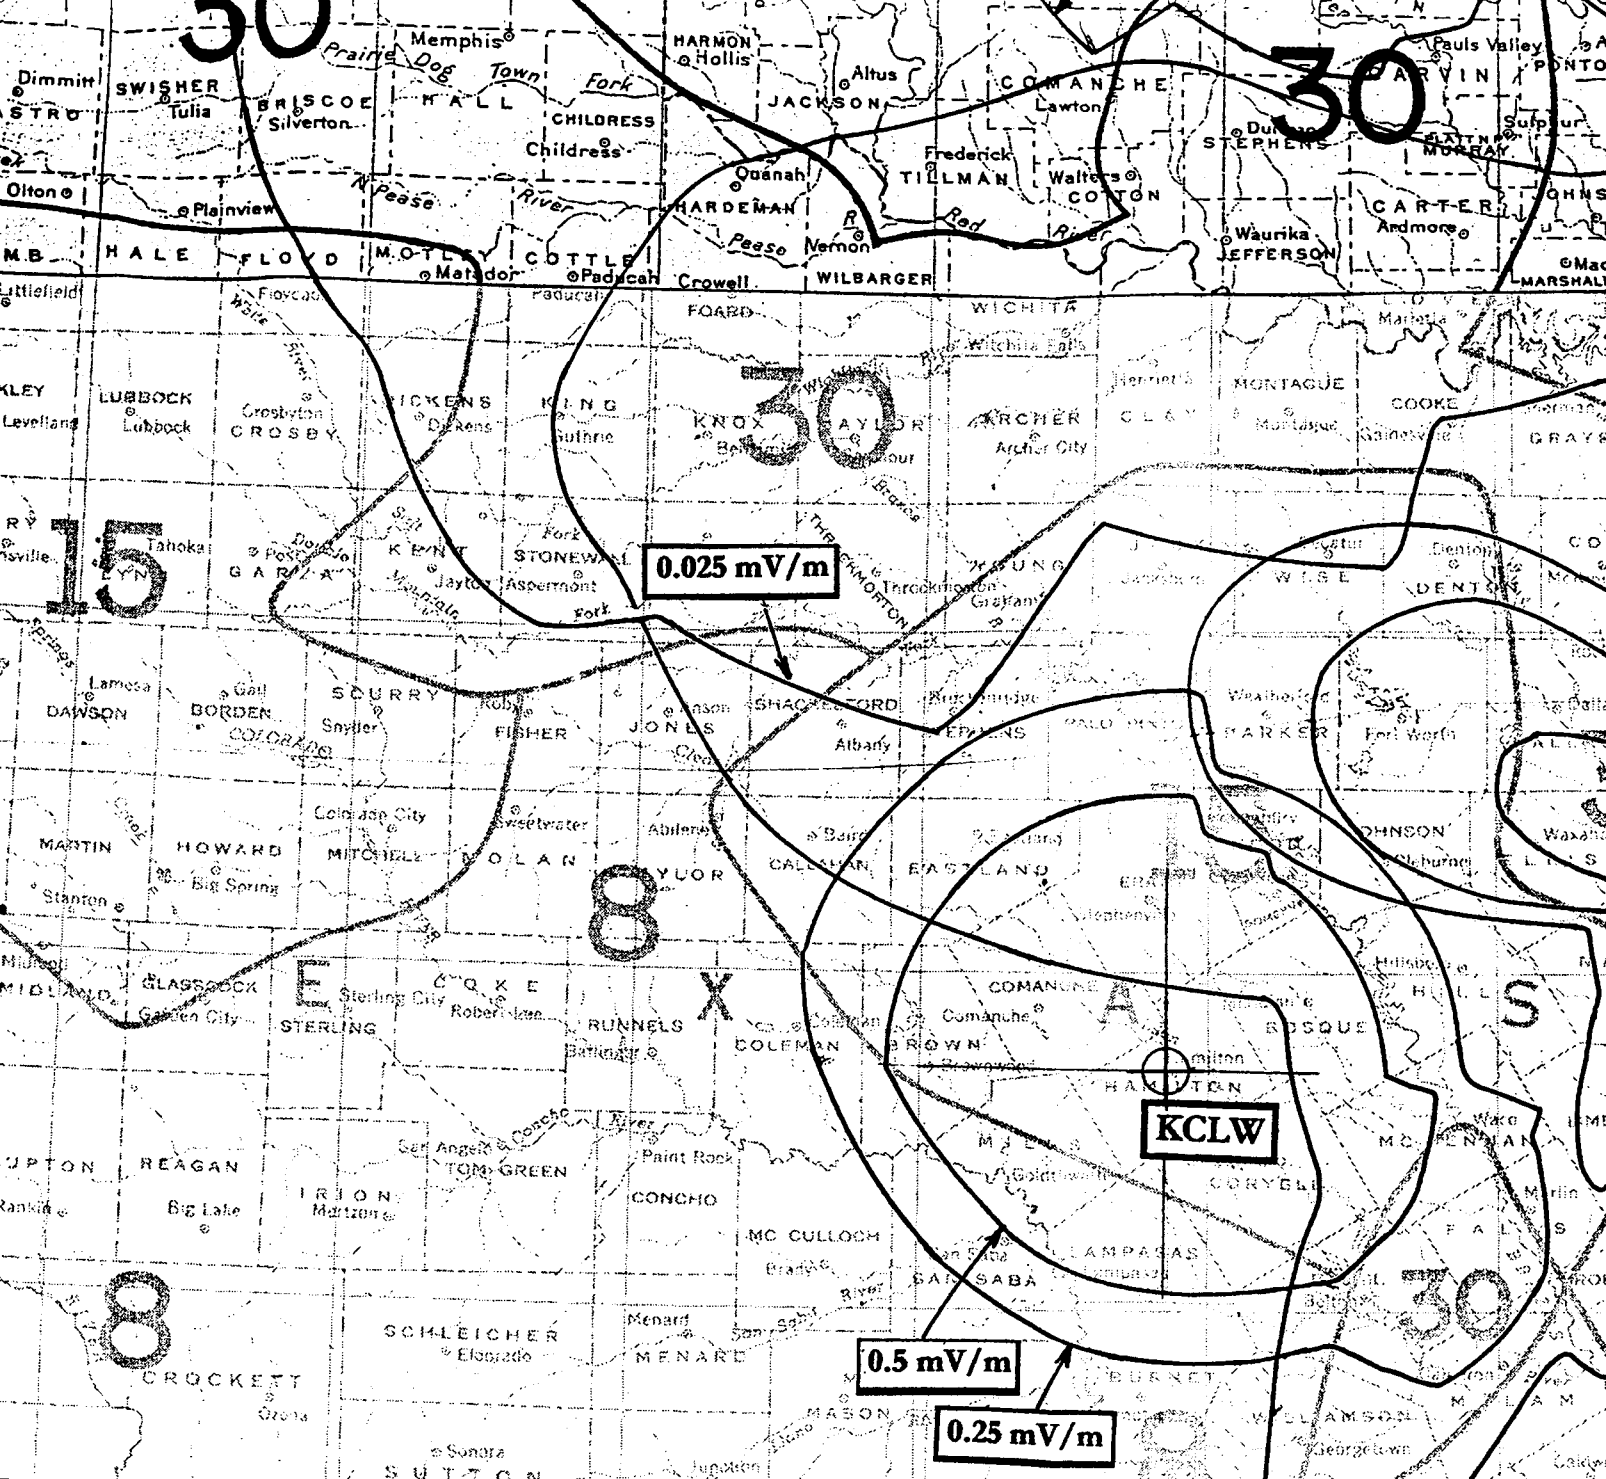

CALL	CITY OF LICENSE	POWER	COORDINATES
Proposed KTXV	Frankston, TX	2 kW DA-2	NL: 32 15' 54" WL: 96 03' 00"
KTLR	Oklahoma City, OK	1 kW ND	NL: 35 33' 59" WL: 97 28' 28"
KCLW	Hamilton, TX	0.25 kW ND	NL: 31 43' 08" WL: 98 08' 39"
KPYN	Atlanta, TX	1 kW ND	NL: 33 04' 53" WL: 94 10' 56"



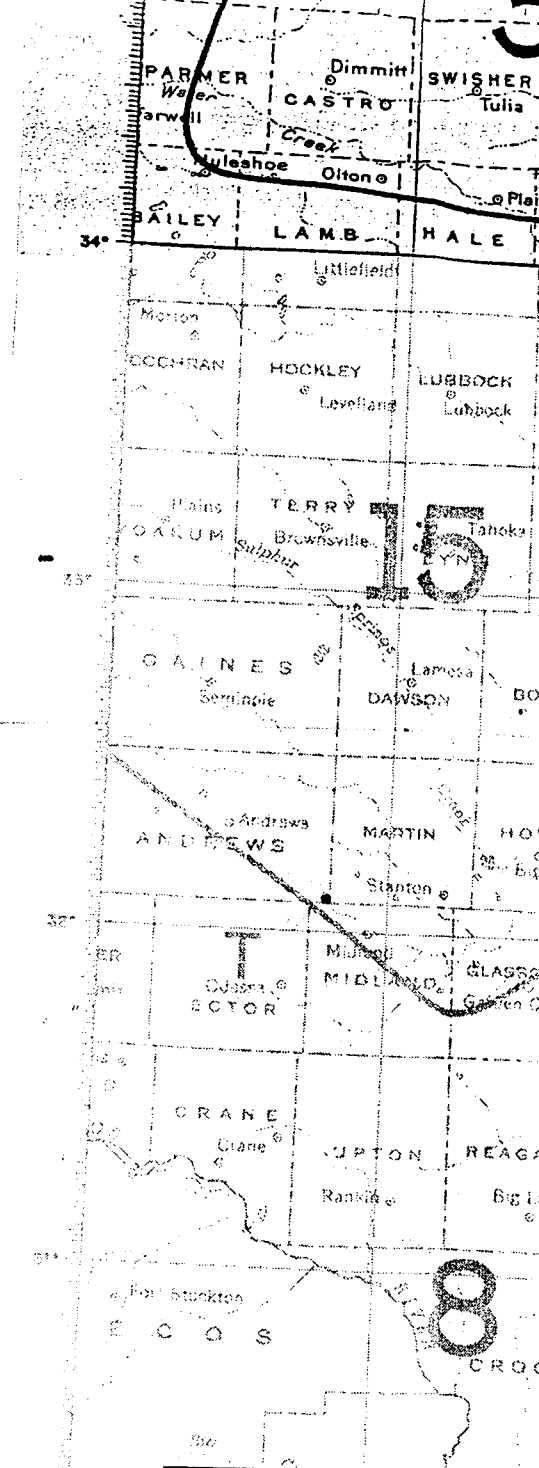

FREQ.	CALL
890 kHz	Proposed KTXV
890 kHz	KTLR
900 kHz	KCLW
900 kHz	KPYN